


LEDPSM-SMPSO-Exhibit 1

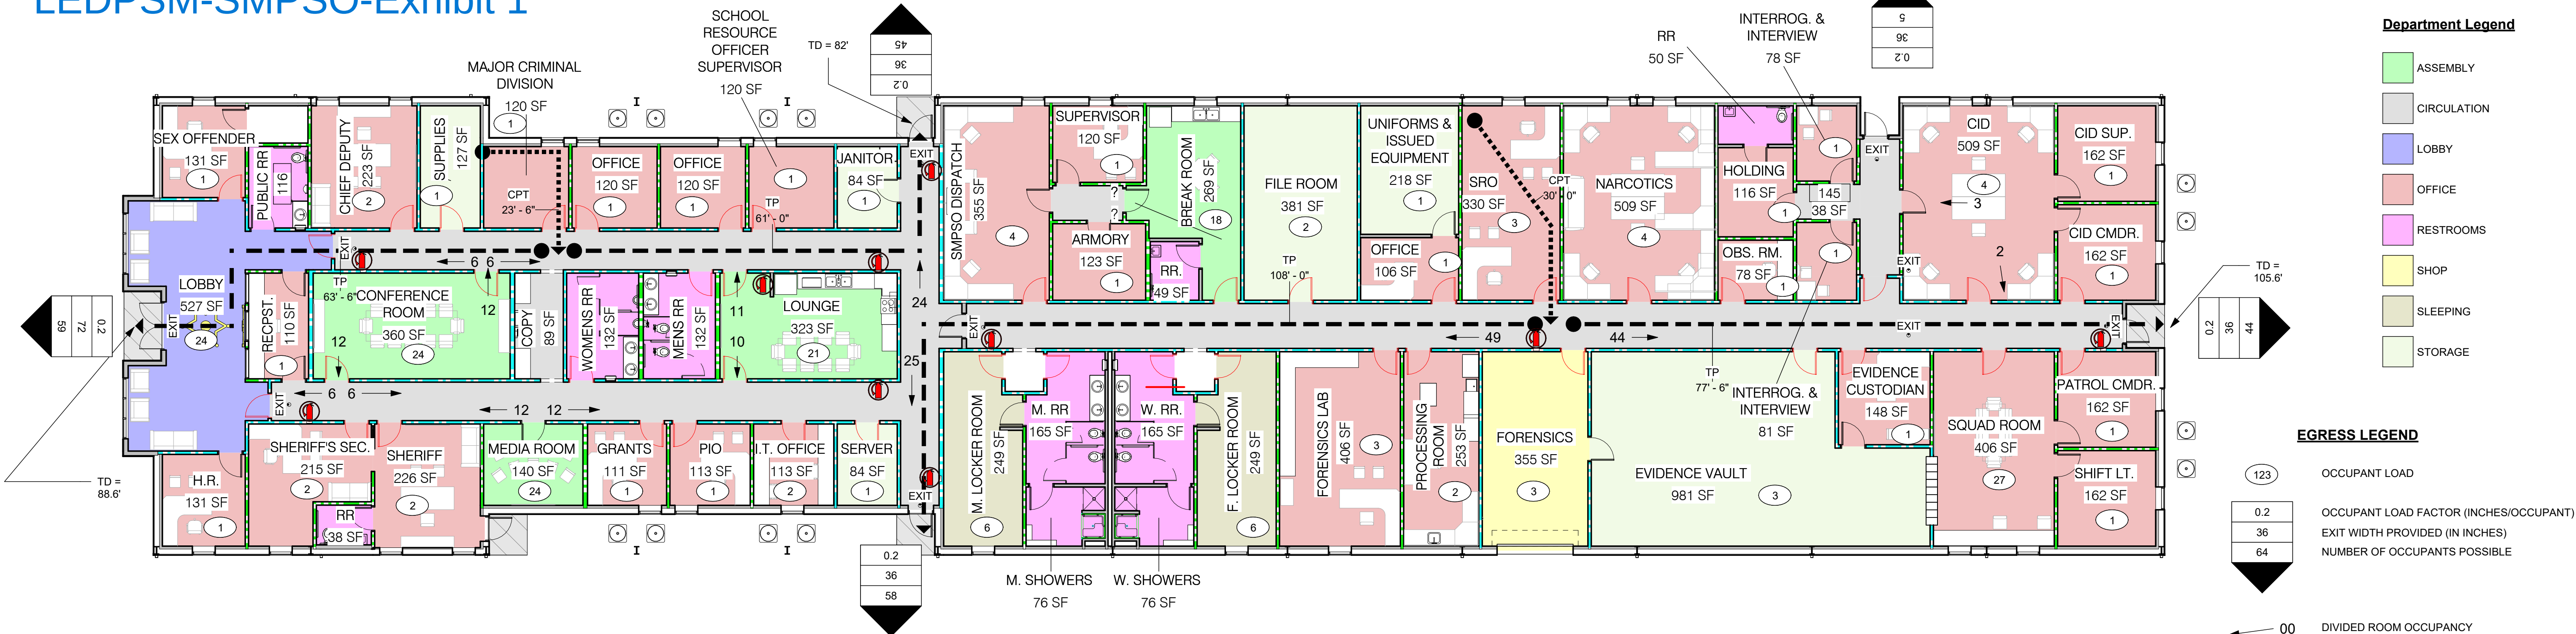

H1 LIFE SAFETY PLAN
3/22" = 1'-0"

TABLE 1020.2 CORRIDOR FIRE-RESISTANCE RATING

OCCUPANCY	OCCUPANT LOAD SERVED BY CORRIDOR	REQUIRED FIRE-RESISTANCE RATING (hours)	
		Without sprinkler system	With sprinkler system
H-1, H-2, H-3	All	Not Permitted	1 ^c
H-4, H-5	Greater than 30	Not Permitted	1 ^c
A, B, E, F, M, S, U	Greater than 30	1	0
R	Greater than 10	Not Permitted	0.55 ^{1d}
I-2 ^a	All	Not Permitted	0
I-1, I-3	All	Not Permitted	1 ^{b, c}
I-4	All	1	0

- a. For requirements for occupancies in Group I-2, see Sections 407.2 and 407.3.
b. For a reduction in the fire-resistance rating for occupancies in Group I-3, see Section 408.8.
c. Buildings equipped throughout with an automatic sprinkler system in accordance with Section 903.3.1.1 or 903.3.1.2 where allowed.
d. Group R-3 and R-4 buildings equipped throughout with an automatic sprinkler system in accordance with Section 903.3.1.3. See Section 903.2.8 for occupancies where automatic sprinkler systems are permitted in accordance with Section 903.3.1.3.

TABLE 506.2 ALLOWABLE AREA FACTOR (A_f = NS, S1, S13R, S13D or SM, as applicable) IN SQUARE FEET^{a, b}

OCCUPANCY CLASSIFICATION	SEE FOOTNOTES	TYPE OF CONSTRUCTION											
		Type I		Type II		Type III		Type IV				Type V	
		A	B	A	B	A	B	A	B	C	HT	A	B
A-1	NS	UL	UL	15,500	8,500	14,000	8,500	45,000	30,000	18,750	15,000	11,500	5,500
	S1	UL	UL	62,000	34,000	56,000	34,000	180,000	120,000	75,000	60,000	46,000	22,000
	SM	UL	UL	46,500	25,500	42,000	25,500	135,000	90,000	56,250	45,000	34,500	16,500
A-2	NS	UL	UL	15,500	9,500	14,000	9,500	45,000	30,000	18,750	15,000	11,500	6,000
	S1	UL	UL	62,000	38,000	56,000	38,000	180,000	120,000	75,000	60,000	46,000	24,000
	SM	UL	UL	46,500	28,500	42,000	28,500	135,000	90,000	56,250	45,000	34,500	18,000
A-3	NS	UL	UL	15,500	9,500	14,000	9,500	45,000	30,000	18,750	15,000	11,500	6,000
	S1	UL	UL	62,000	38,000	56,000	38,000	180,000	120,000	75,000	60,000	46,000	24,000
	SM	UL	UL	46,500	28,500	42,000	28,500	135,000	90,000	56,250	45,000	34,500	18,000
A-4	NS	UL	UL	15,500	9,500	14,000	9,500	45,000	30,000	18,750	15,000	11,500	6,000
	S1	UL	UL	62,000	38,000	56,000	38,000	180,000	120,000	75,000	60,000	46,000	24,000
	SM	UL	UL	46,500	28,500	42,000	28,500	135,000	90,000	56,250	45,000	34,500	18,000
A-5	NS	UL	UL	15,500	9,500	14,000	9,500	45,000	30,000	18,750	15,000	11,500	6,000
	S1	UL	UL	62,000	38,000	56,000	38,000	180,000	120,000	75,000	60,000	46,000	24,000
	SM	UL	UL	46,500	28,500	42,000	28,500	135,000	90,000	56,250	45,000	34,500	18,000
B	NS	UL	UL	37,500	23,000	28,500	19,000	108,000	72,000	45,000	36,000	18,000	9,000
	S1	UL	UL	150,000	92,000	114,000	76,000	432,000	288,000	180,000	144,000	72,000	36,000
	SM	UL	UL	112,500	69,000	85,500	57,000	324,000	216,000	135,000	108,000	54,000	27,000
E	NS	UL	UL	26,500	14,500	23,500	14,500	76,500	51,000	31,875	25,500	18,500	9,500
	S1	UL	UL	106,000	58,000	94,000	58,000	306,000	204,000	127,500	102,000	74,000	38,000
	SM	UL	UL	79,500	43,500	70,500	43,500	229,500	153,000	95,625	76,500	55,500	28,500
F-1	NS	UL	UL	25,000	15,500	19,000	12,000	100,500	67,000	41,875	33,500	14,000	8,500
	S1	UL	UL	100,000	62,000	76,000	48,000	402,000	268,000	167,500	134,000	56,000	34,000
	SM	UL	UL	75,000	46,500	57,000	36,000	301,500	201,000	125,625	100,500	42,000	25,500

TABLE 508.4 REQUIRED SEPARATION OF OCCUPANCIES (HOURS)^f

OCCUPANCY	A, E		I-1 ^a , I-3, I-4		I-2		R ^b		F-2, S-2 ^b , U		B ^c , F-1, M, S-1		H-1		H-2		H-3, H-4		H-5	
	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS	S	NS
A, E	N	N	1	2	2	NP	1	2	N	1	1	2	NP	NP	3	4	2	3	2	NP
I-1 ^a , I-3, I-4	1	2	N	N	2	NP	1	NP	1	2	1	2	NP	NP	3	NP	2	NP	2	NP
I-2	2	NP	2	NP	N	N	2	NP	2	NP	2	NP	NP	NP	3	NP	2	NP	2	NP
R ^b	1	2	1	NP	2	NP	N	N	1 ^c	2 ^c	1	2	NP	NP	3	NP	2	NP	2	NP
F-2, S-2 ^b , U	N	1	1	2	2	NP	1 ^c	2 ^c	N	N	1	2	NP	NP	3	4	2	3	2	NP
B ^c , F-1, M, S-1	1	2	1	2	2	NP	1	2	1	2	N	N	NP	NP	2	3	1	2	1	NP
H-1	NP	NP	NP	NP	NP	NP	NP	NP	NP	NP	NP	NP	N	NP	NP	NP	NP	NP	NP	NP
H-2	3	4	3	NP	3	NP	3	NP	3	4	2	3	NP	NP	N	NP	1	NP	1	NP
H-3, H-4	2	3	2	NP	2	NP	2	NP	2	3	1	2	NP	NP	1	NP	1 ^d	NP	1	NP
H-5	2	NP	2	NP	2	NP	2	NP	2	NP	1	NP	NP	NP	1	NP	1	N	NP	NP

- S = Buildings equipped throughout with an automatic sprinkler system installed in accordance with Section 903.3.1.1.
NS = Buildings not equipped throughout with an automatic sprinkler system installed in accordance with Section 903.3.1.1.
N = No separation requirement.
NP = Not Permitted.
a. See Section 420.
b. The required separation from areas used only for private or pleasure vehicles shall be reduced by 1 hour but not to less than 1 hour.
c. See Sections 406.3.2 and 406.6.4.
d. Separation is not required between occupancies of the same classification.
e. See Section 422.2 for ambulatory care facilities.
f. Occupancy separations that serve to define fire area limits established in Chapter 9 for requiring fire protection systems shall also comply with Section 707.3.10 and Table 707.3.10 in accordance with Section 901.7.

508.4.1 Occupancy classification.

Separated occupancies shall be individually classified in accordance with Section 302.1. Each separated space shall comply with this code based on the occupancy classification of that portion of the building. The most restrictive provisions of Chapter 9 that apply to the separate occupancies shall apply to the total nonfire-barrier-separated occupancy areas. Occupancy separations that serve to define fire area limits established in Chapter 9 for requiring a fire protection system shall also comply with Section 901.7.

INTERIOR ROOM AREAS

ROOM NUMBER	ROOM NAME	Area
101	LOBBY	527 SF
102	H.R.	131 SF
103	SEX OFFENDER	131 SF
104	CHIEF DEPUTY	223 SF
105	SUPPLIES	127 SF
106	MAJOR CRIMINAL DIVISION	120 SF
107	OFFICE	120 SF
108	OFFICE	120 SF
109	SCHOOL RESOURCE OFFICER SUPERVISOR	120 SF
110	JANITOR	84 SF
111	LOUNGE	323 SF
112	MENS RR	132 SF
113	WOMENS RR	132 SF
114	COPY	89 SF
115	CONFERENCE ROOM	360 SF
116	PUBLIC RR	84 SF
117	RECPST.	110 SF
118	SHERIFF'S SEC.	215 SF
119	SHERIFF	226 SF
120	RR	38 SF
121	MEDIA ROOM	140 SF
122	GRANTS	111 SF
123	PIO	113 SF
124	I.T. OFFICE	113 SF
125	SERVER	84 SF
126	CORR.	377 SF
127	CORR.	419 SF
128	CORR.	256 SF
129	SMPSO DISPATCH	355 SF
130	SUPERVISOR	120 SF
131	CORR.	42 SF
132	ARMORY	123 SF
133	BREAK ROOM	269 SF
134	RR	49 SF
135	FILE ROOM	381 SF
136	UNIFORMS & ISSUED EQUIPMENT	218 SF
137	OFFICE	106 SF
138	SRO	330 SF
139	NARCOTICS	509 SF
140	HOLDING	116 SF
141	RR	50 SF
142	INTERROG. & INTERVIEW	78 SF
143	INTERROG. & INTERVIEW	81 SF
144	OBS. RM.	78 SF
145	CORR.	38 SF
146	CORR.	93 SF
147	CID	509 SF
148	CID SUP.	162 SF
149	CID CMDR.	162 SF
150	CORR.	914 SF
151	PATROL CMDR.	162 SF
152	SHIFT LT.	162 SF
153	SQUAD ROOM	406 SF
154	EVIDENCE CUSTODIAN	148 SF
155	EVIDENCE VAULT	981 SF
156	FORENSICS	355 SF
157	PROCESSING ROOM	253 SF
158	FORENSICS LAB	406 SF
159	F. LOCKER ROOM	249 SF
160	W. RR	165 SF
161	W. SHOWERS	76 SF
162	M. RR	165 SF
163	M. SHOWERS	76 SF
164	M. LOCKER ROOM	249 SF
165	FILES	38 SF
Grand total: 65		13896 SF

BUILDING CODES: INTERNATIONAL BUILDING CODE: NFPA 101 LIFE SAFETY:		2021 EDITION 2015 EDITION
WIND LOAD DESIGN:		142
MIN ROOF LIVE LOAD (IBC 1607): MIN FLOOR LIVE LOAD (IBC 1607):		20 PSF 50 PSF
RISK CATEGORY:		II
EXPOSURE CATEGORY:		B
ALLOWABLE FLOOR AREA (IBC CH. 5):		23,000 S.F.
CONSTRUCTION TYPE (IBC CH. 6):		IIIB
FIRE DISTANCE SEPARATION (TABLE 705.5):		X > 30
OCCUPANCY TYPE: IBC: NFPA:		B BUSINESS
OCCUPANCY LOAD (CH. 10):		189
FIRE PROTECTION: SPRINKLED: FIRE RESISTANCE (CH. 7):		NO NONE
BUILDING AREA: NUMBER OF FLOORS: AREA PER IBC: TOTAL BUILDING SLAB:		1 14,488 S.F. 15,188 S.F.
PARKING: PARKING: ACCESSIBLE PARKING:		TBD TBD
FIRE EXTINGUISHERS: PROVIDED:		RE: LIFE SAFETY PLAN
NOTE:		
A. ALL CORRIDORS ARE 1 HOUR FIRE RATED TUNNELS PER DETAILS		
B. ALL DOORS ENTERING/EXISTING CORRIDORS ARE 20MIN RATED (SEE DOOR SCHEDULE)		

NEW
ST. MARY PARISH SHERIFF'S
COMPLEX

SCHEMATIC
DESIGN REVIEW

REVISIONS

Date	Description

Project No. 23017

Drawn By DKH

Checked By GA

Date JAN. 19, 2024

Scale As indicated


Drawing Title

LIFE SAFETY PLAN


Drawing No.

A-006

1/18/2024 4:57:29 PM

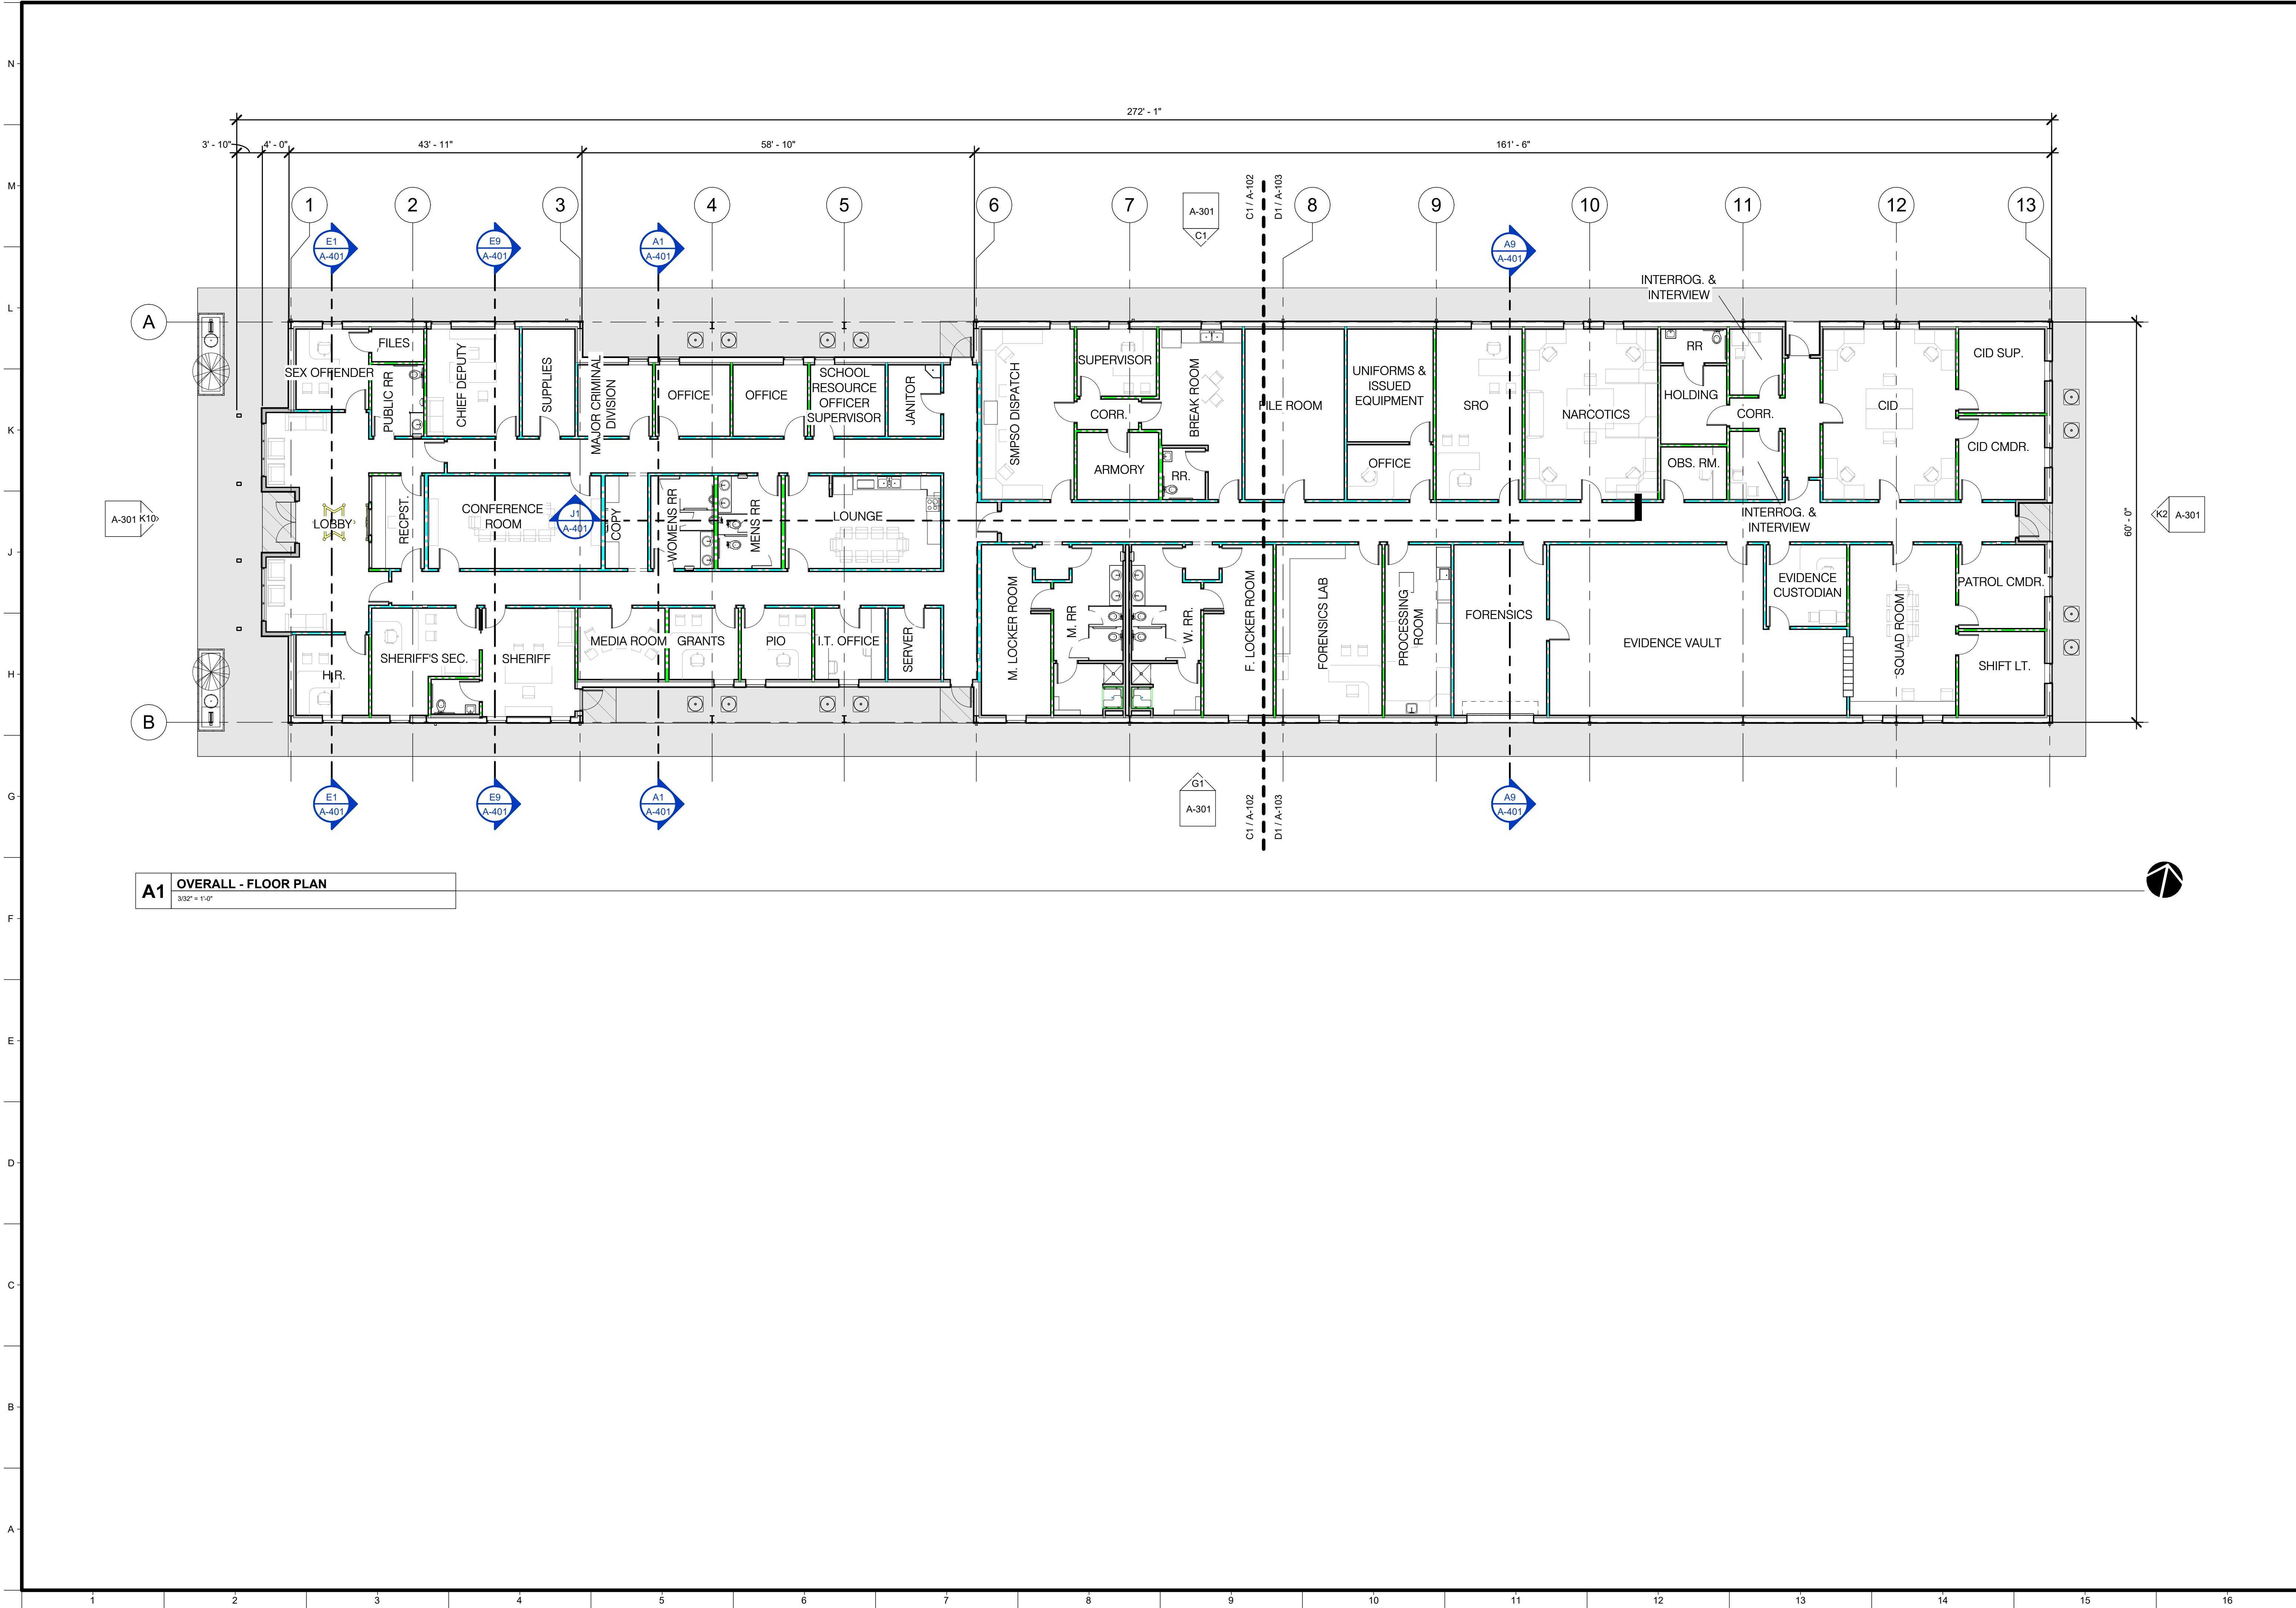

A1 OVERALL - FLOOR PLAN
3/32" = 1'-0"

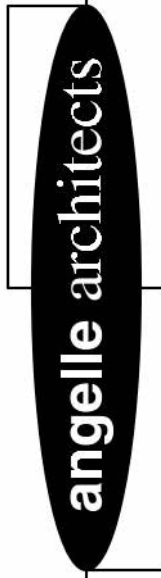

Limited Liability Company
1011 Berard Street • Breaux Bridge, LA • (337) 332-6688 • www.angelle.com

NEW

ST. MARY PARISH SHERIFF'S COMPLEX

...

SCHEMATIC DESIGN REVIEW

REVISIONS

Date	Description

Project No.

23017

Drawn By

DKH

Checked By

GA

Date

JAN. 19, 2024

Scale

3/32" = 1'-0"


Drawing Title

FLOOR PLAN

Drawing No.

A-101

1/18/2024 4:57:30 PM

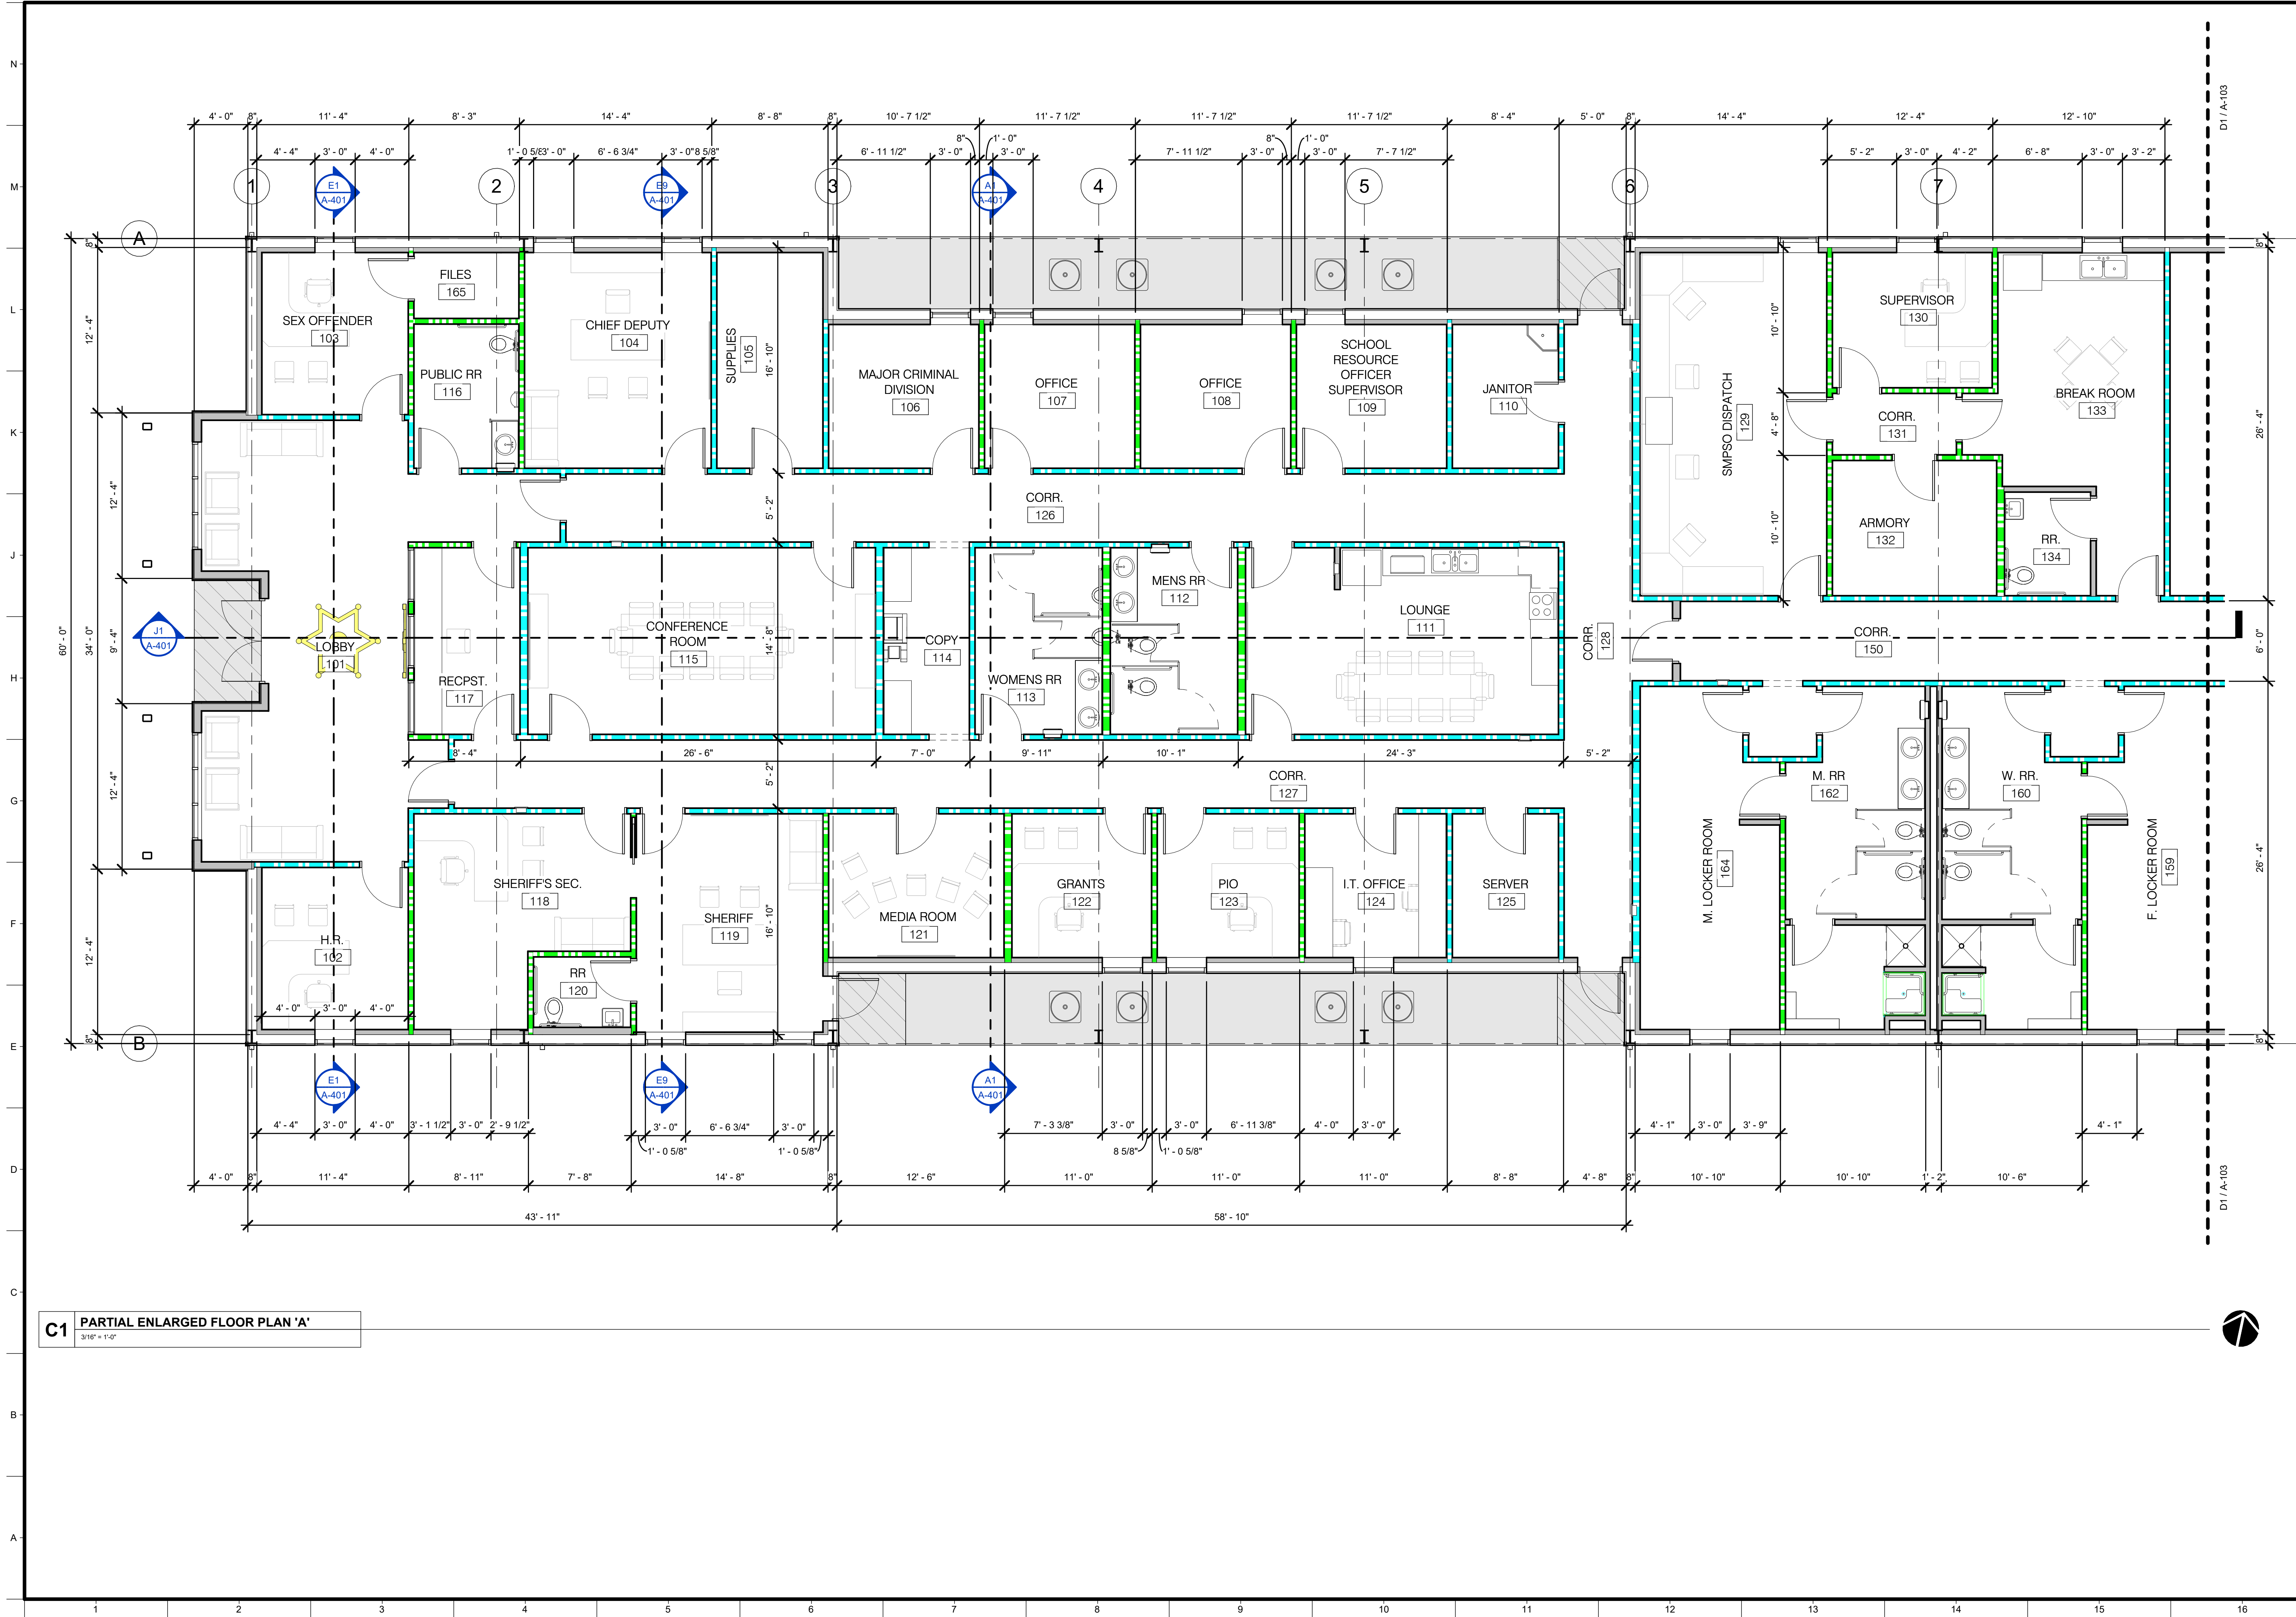

NEW


ST. MARY PARISH SHERIFF'S COMPLEX

...

SCHEMATIC DESIGN REVIEW

REVISIONS	
Date	Description
Project No. 23017	
Drawn By	DKH
Checked By	GA
Date	JAN. 19, 2024
Scale	3/16" = 1'-0"
Drawing Title PARTIAL ENLARGED FLOOR PLAN 'A'	
Drawing No. A-102	

1/18/2024 4:57:30 PM

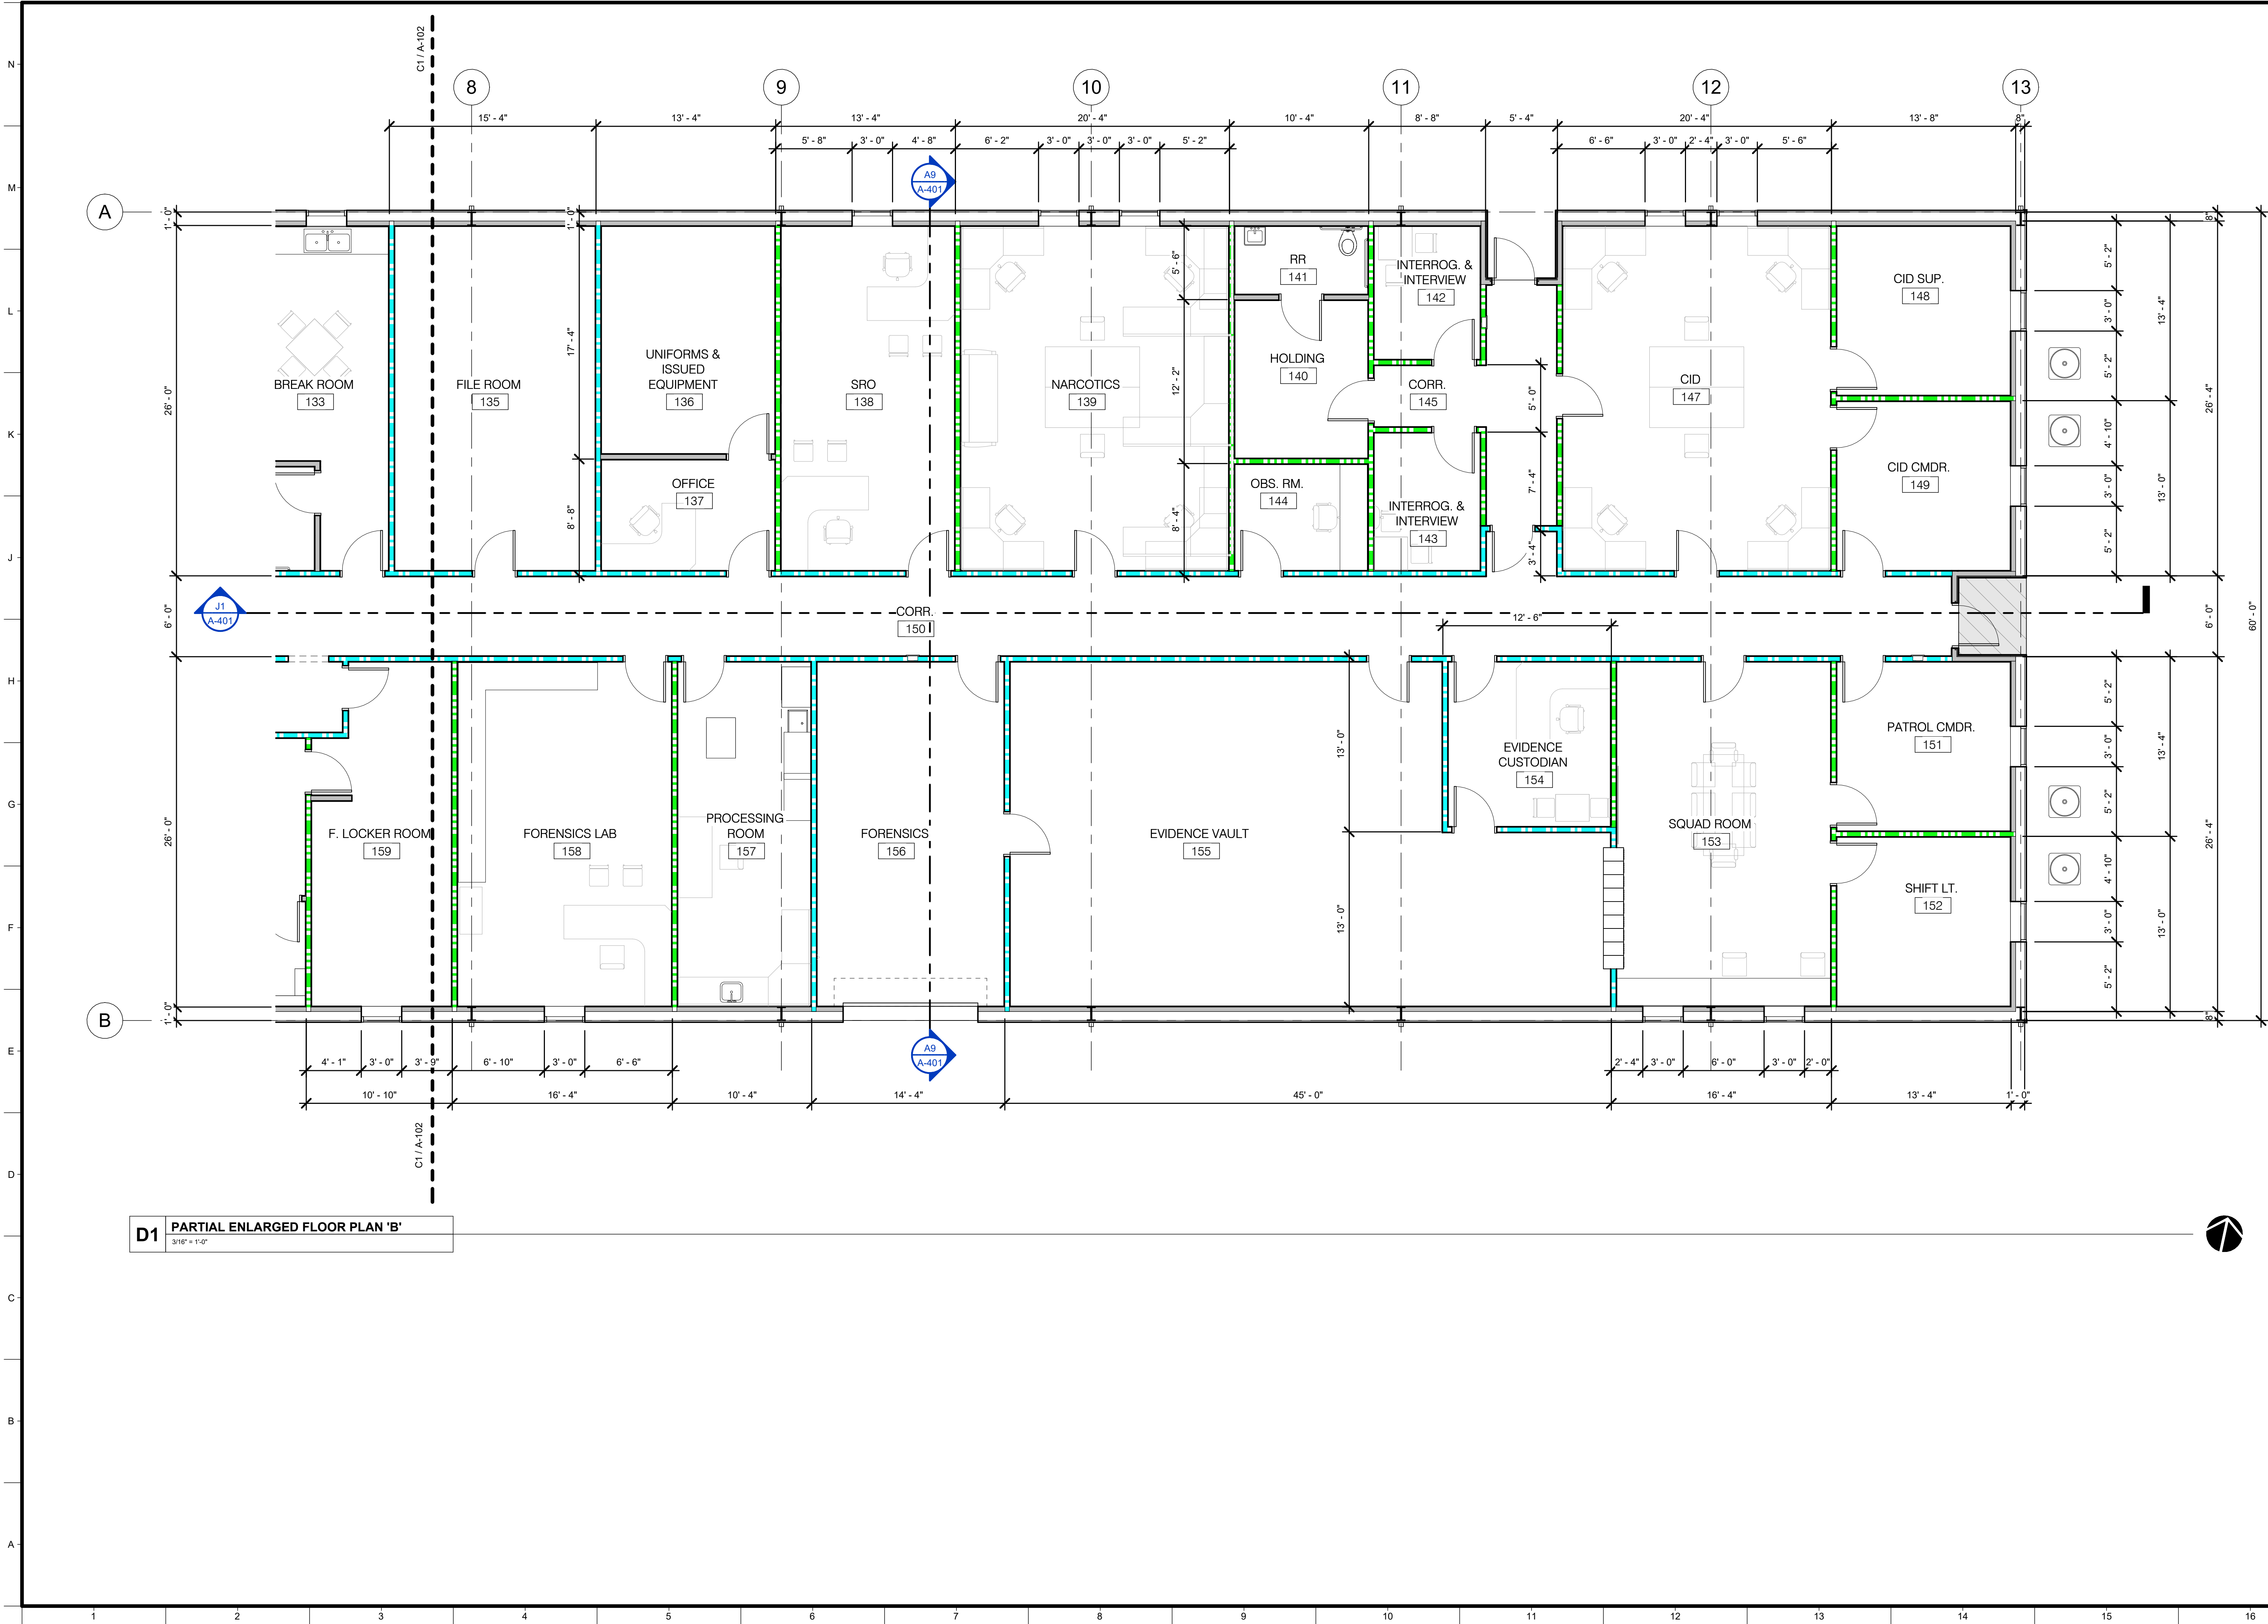

NEW


ST. MARY PARISH SHERIFF'S COMPLEX

...


**SCHEMATIC
DESIGN REVIEW**

REVISIONS	
Date	Description
Project No. 23017	
Drawn By	DKH
Checked By	GA
Date	JAN. 19, 2024
Scale	3/16" = 1'-0"
Drawing Title PARTIAL ENLARGED FLOOR PLAN 'B'	
Drawing No. A-103	


1/18/2024 4:57:35 PM

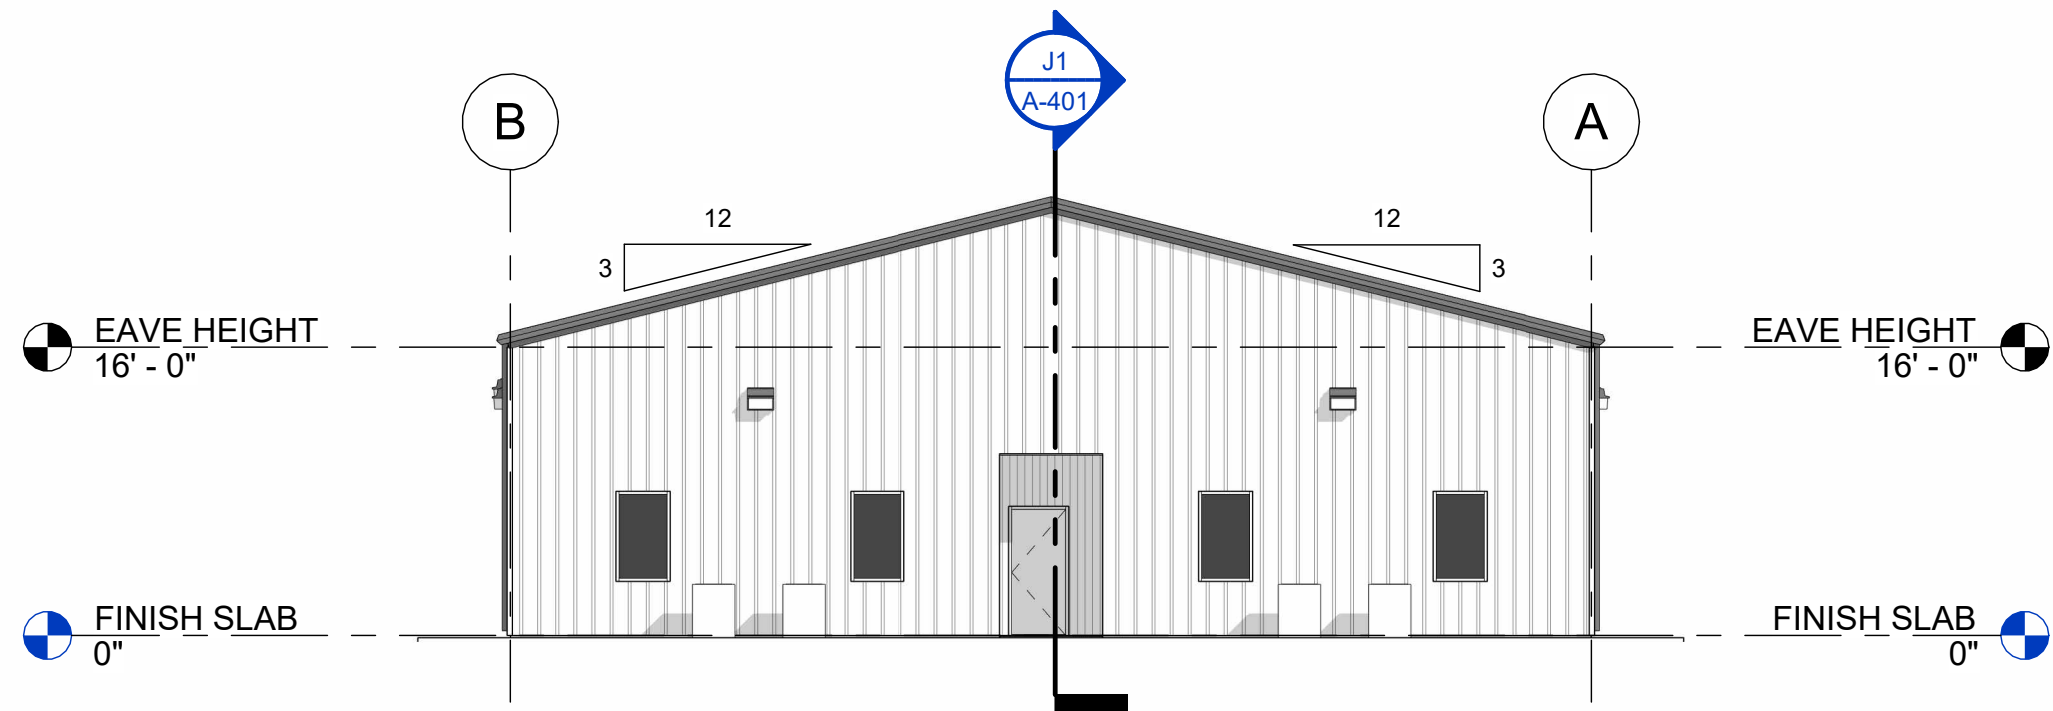


K2 NORTH ELEVATION
3/32" = 1'-0"

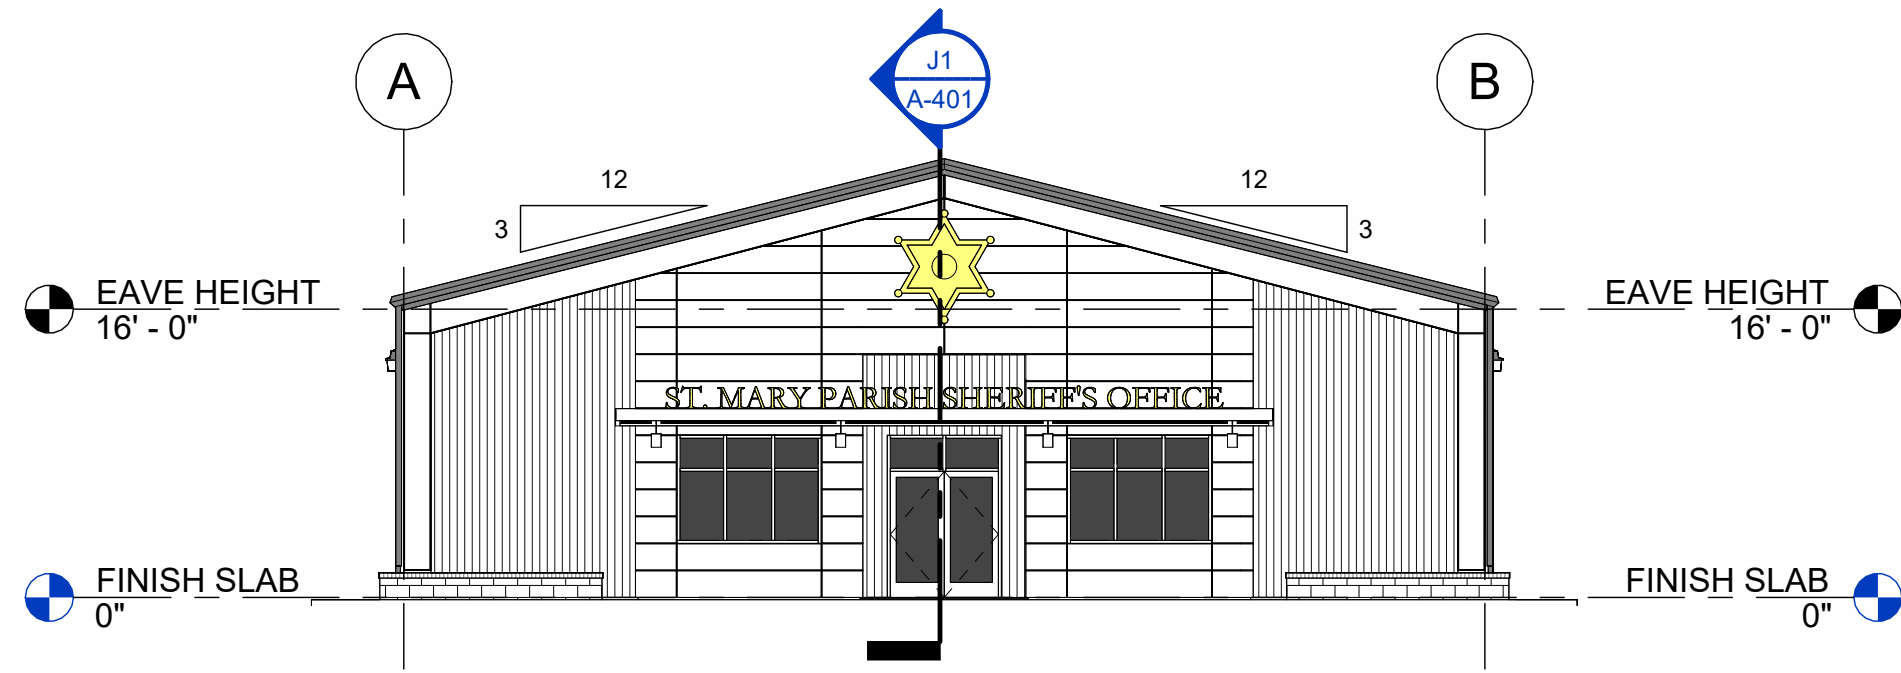

K10 SOUTH ELEVATION
3/32" = 1'-0"

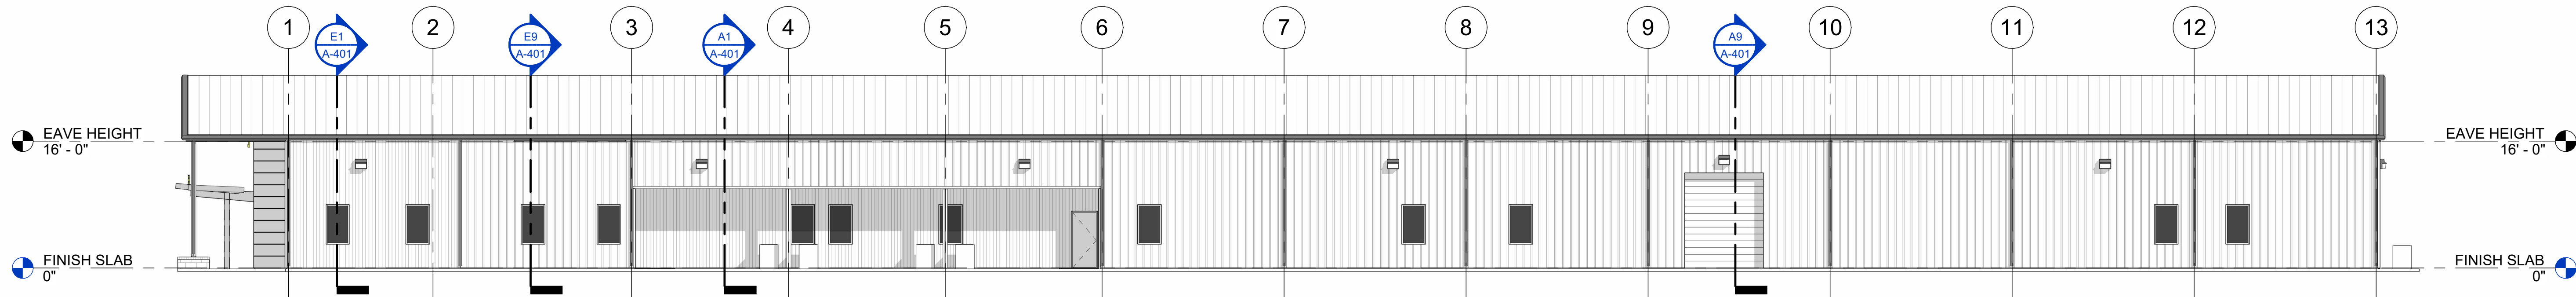

G1 EAST ELEVATION
3/32" = 1'-0"

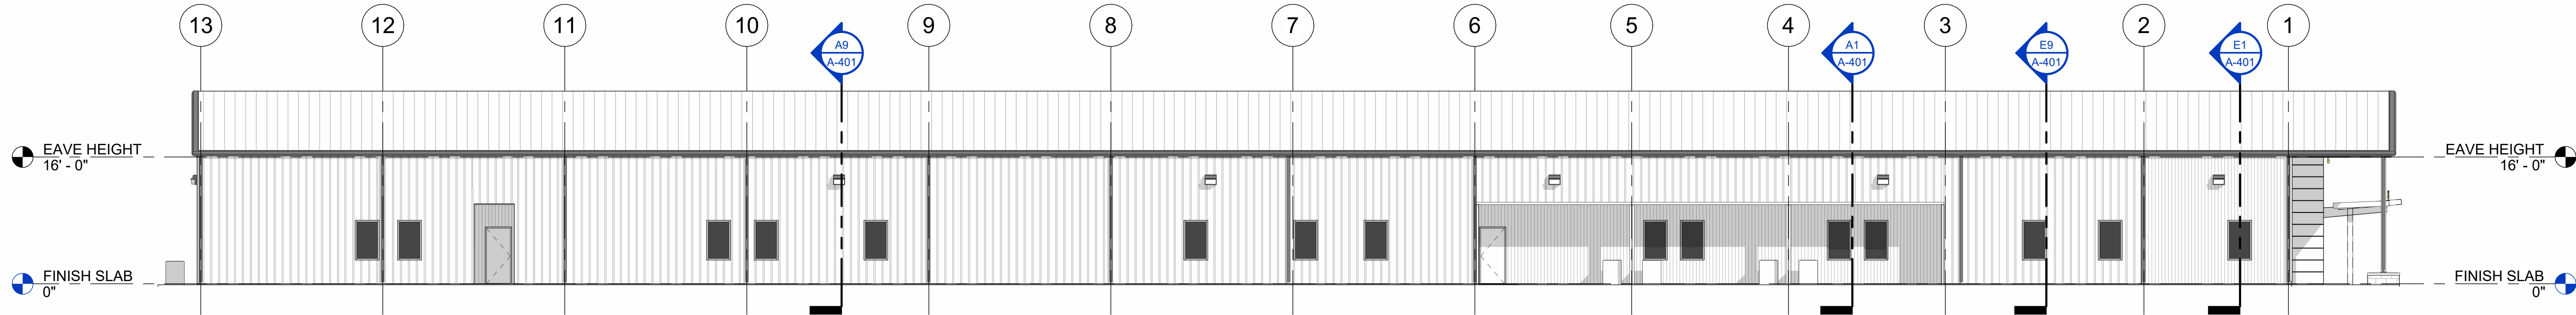

C1 WEST ELEVATION
3/32" = 1'-0"

angelle architects

Limited Liability Company
1011 Berard Street • Breaux Bridge LA • (337) 332-6688 • www.angelle.com

NEW
ST. MARY PARISH SHERIFF'S
COMPLEX

SCHEMATIC
DESIGN REVIEW

REVISIONS

Date	Description

Project No. 23017

Drawn By DKH

Checked By GA

Date JAN. 19, 2024

Scale 3/32" = 1'-0"




Drawing Title
BUILDING ELEVATIONS

Drawing No.

A-301

1/18/2024 4:57:40 PM

N
M
L
K
J
H
G
F
E
D
C
B
A

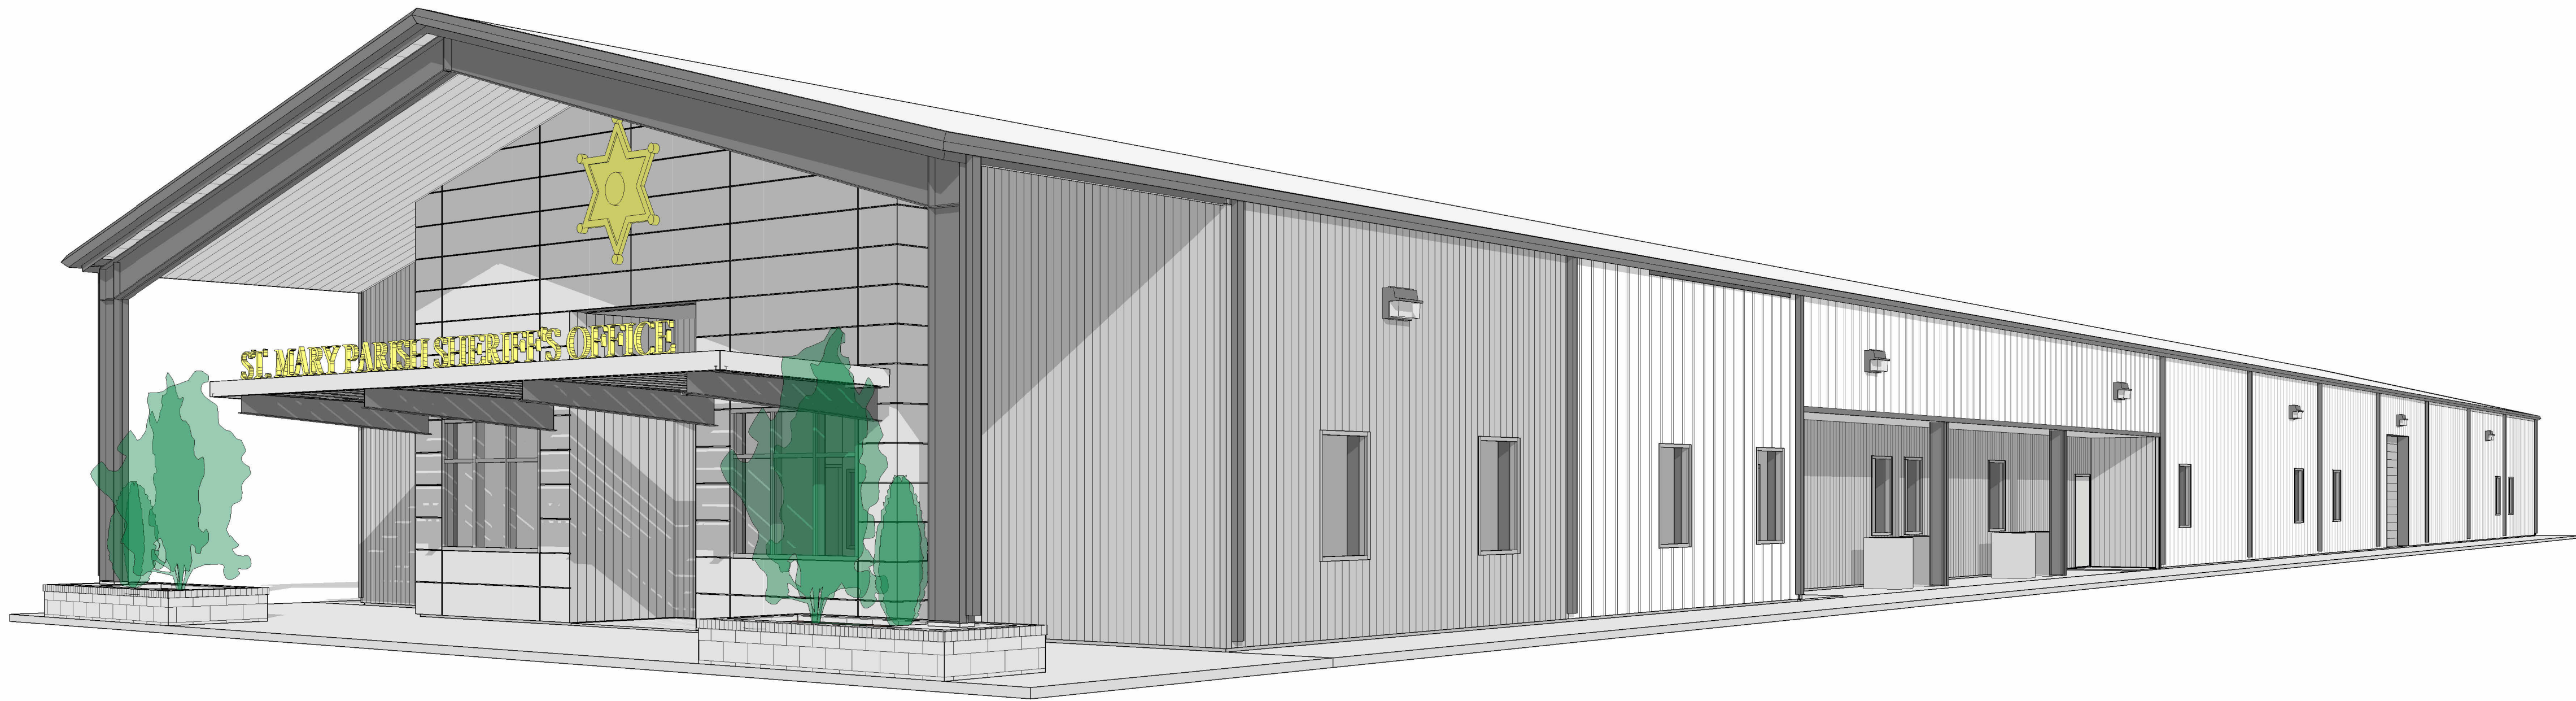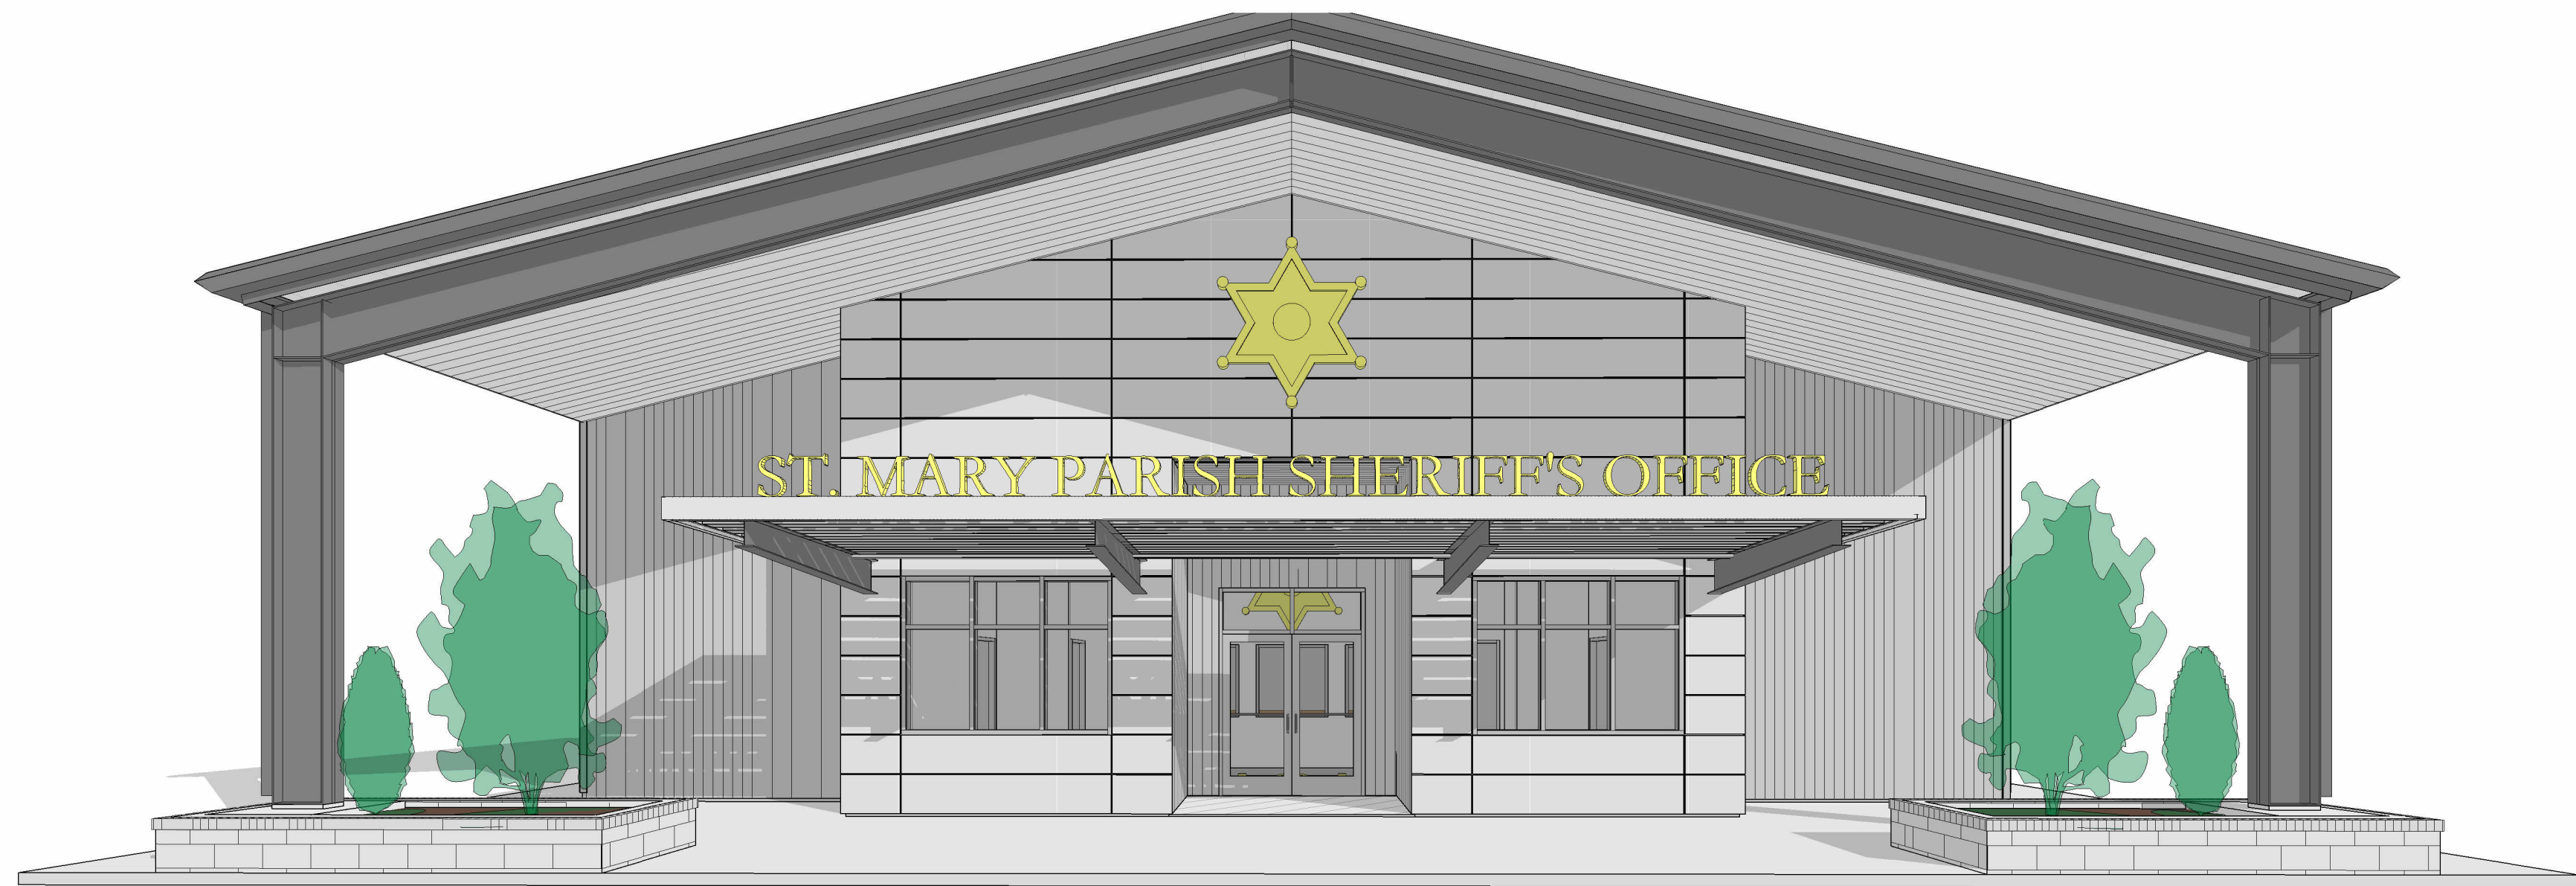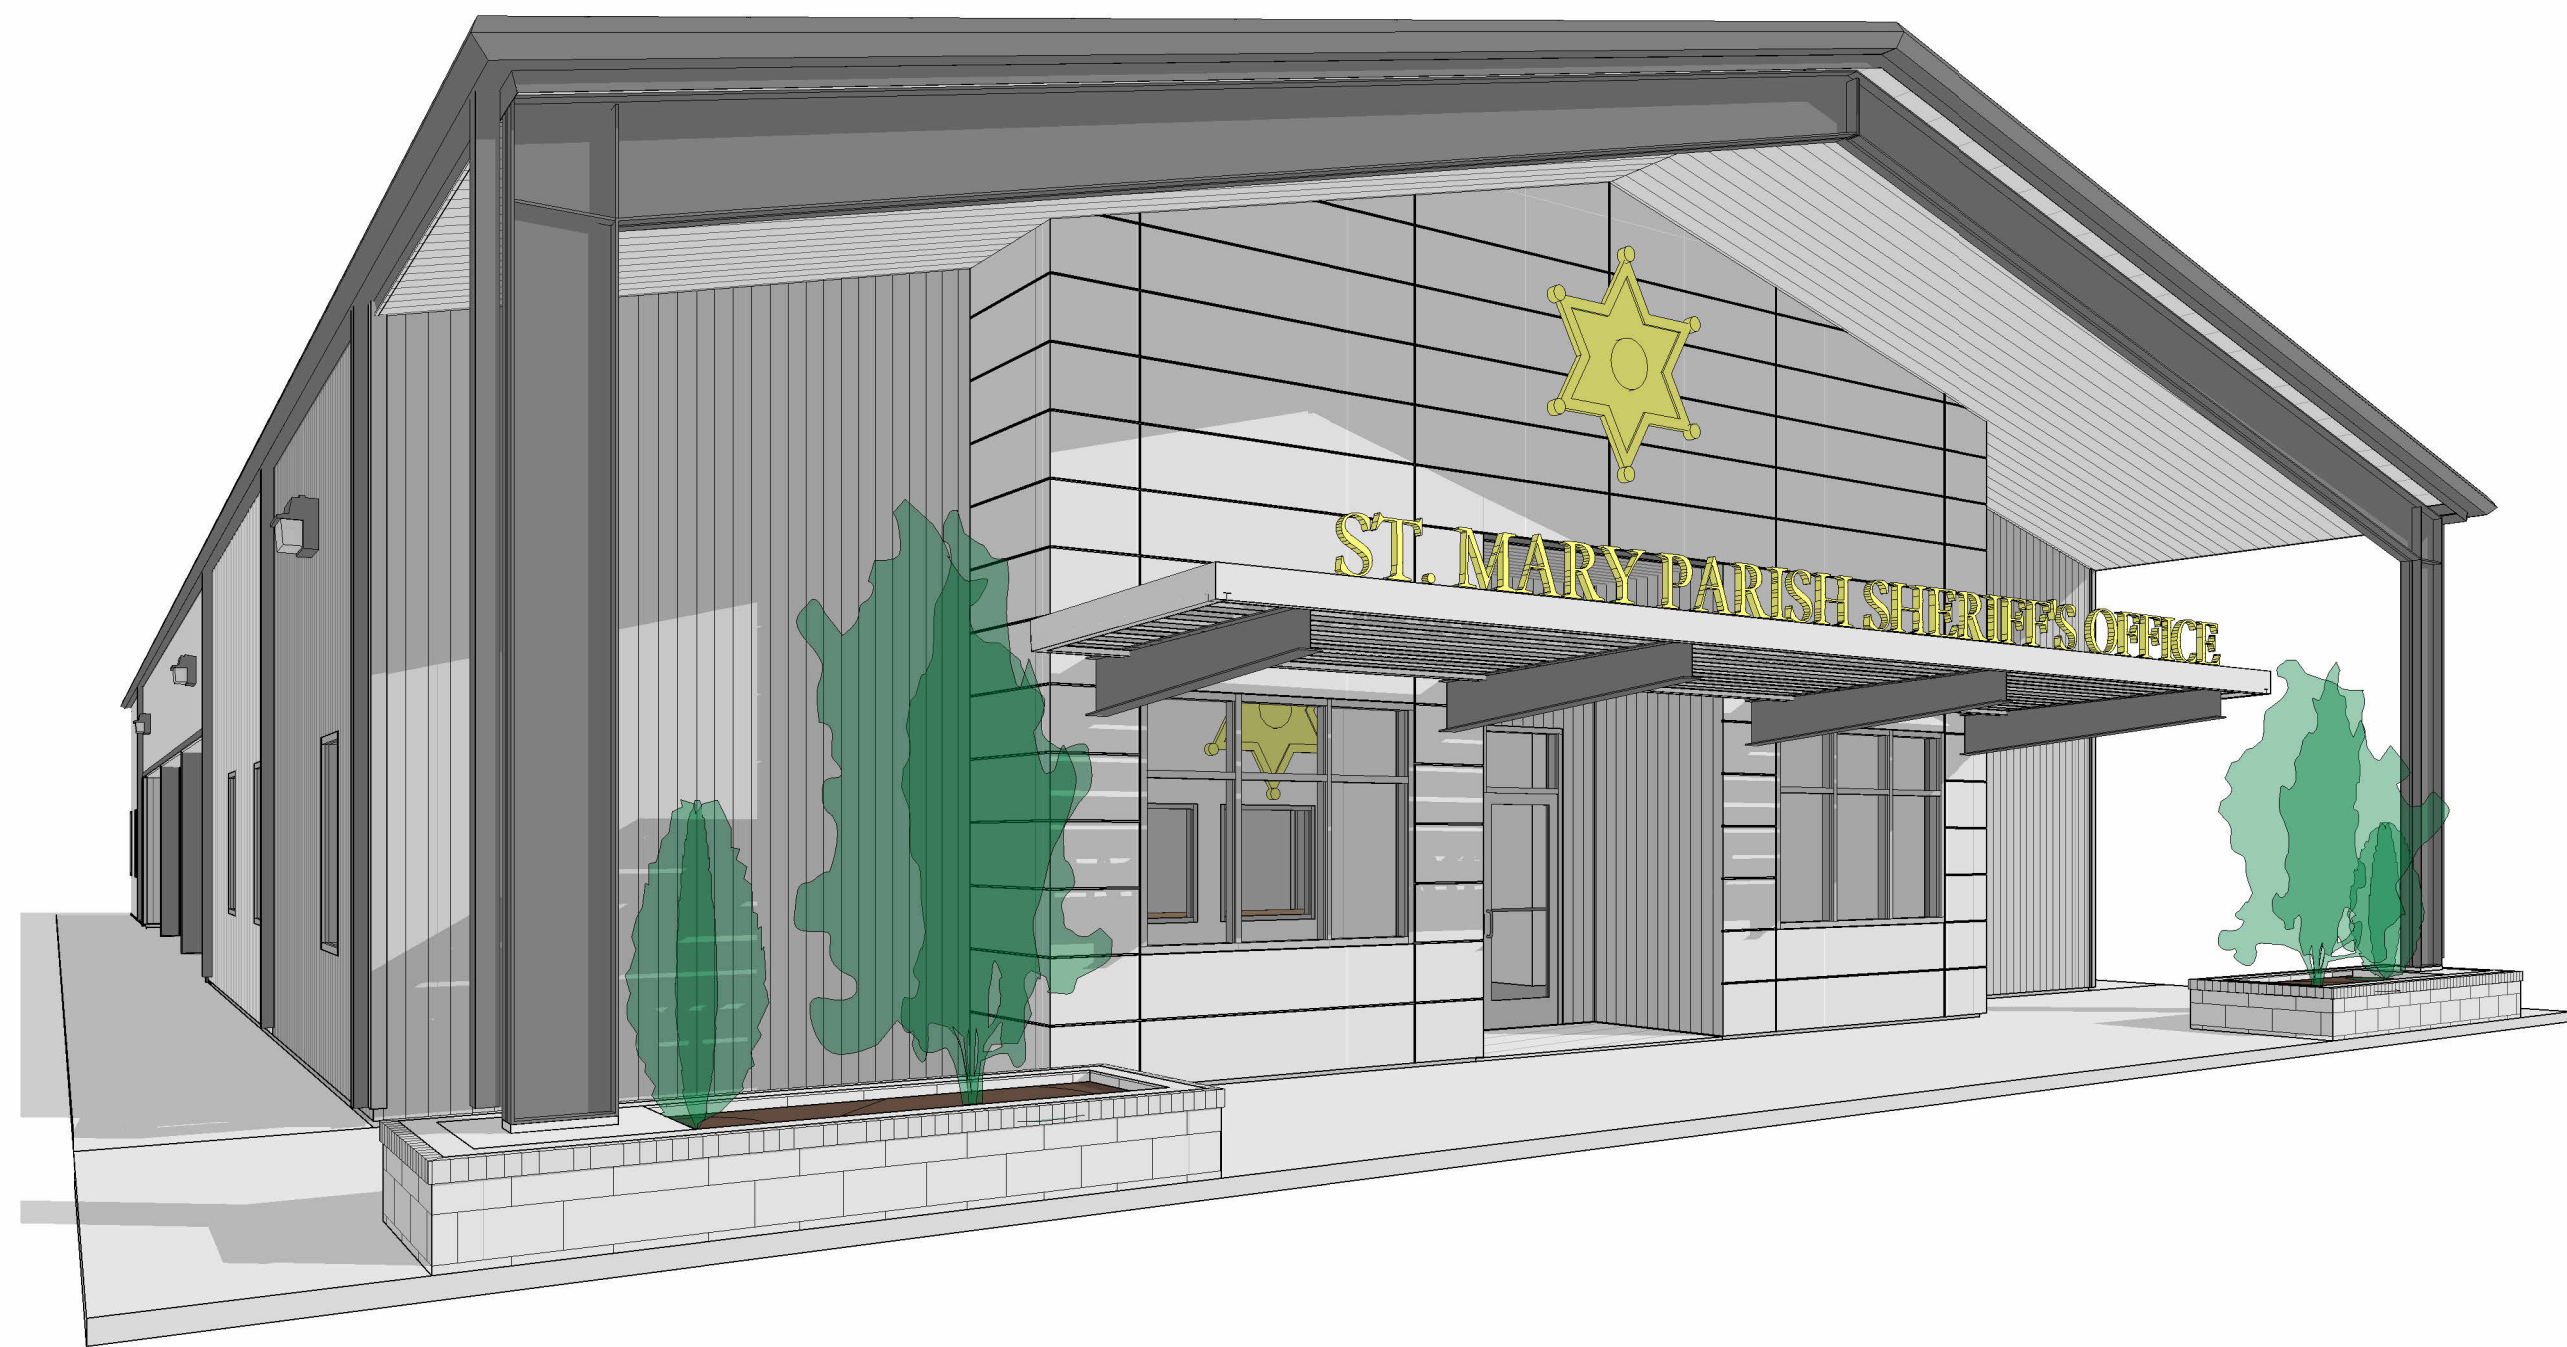

1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16

angelle architects

Limited Liability Company
1011 Berard Street • Breaux Bridge LA • (337) 332-6688 • www.angelle.com

NEW
ST. MARY PARISH SHERIFF'S
COMPLEX

SCHEMATIC
DESIGN REVIEW

REVISIONS

Date	Description

Project No. 23017

Drawn By DKH

Checked By GA

Date JAN. 19, 2024


Scale

Drawing Title
EXTERIOR 3D VIEWS


Drawing No.

A-005


1/18/2024 4:57:42 PM

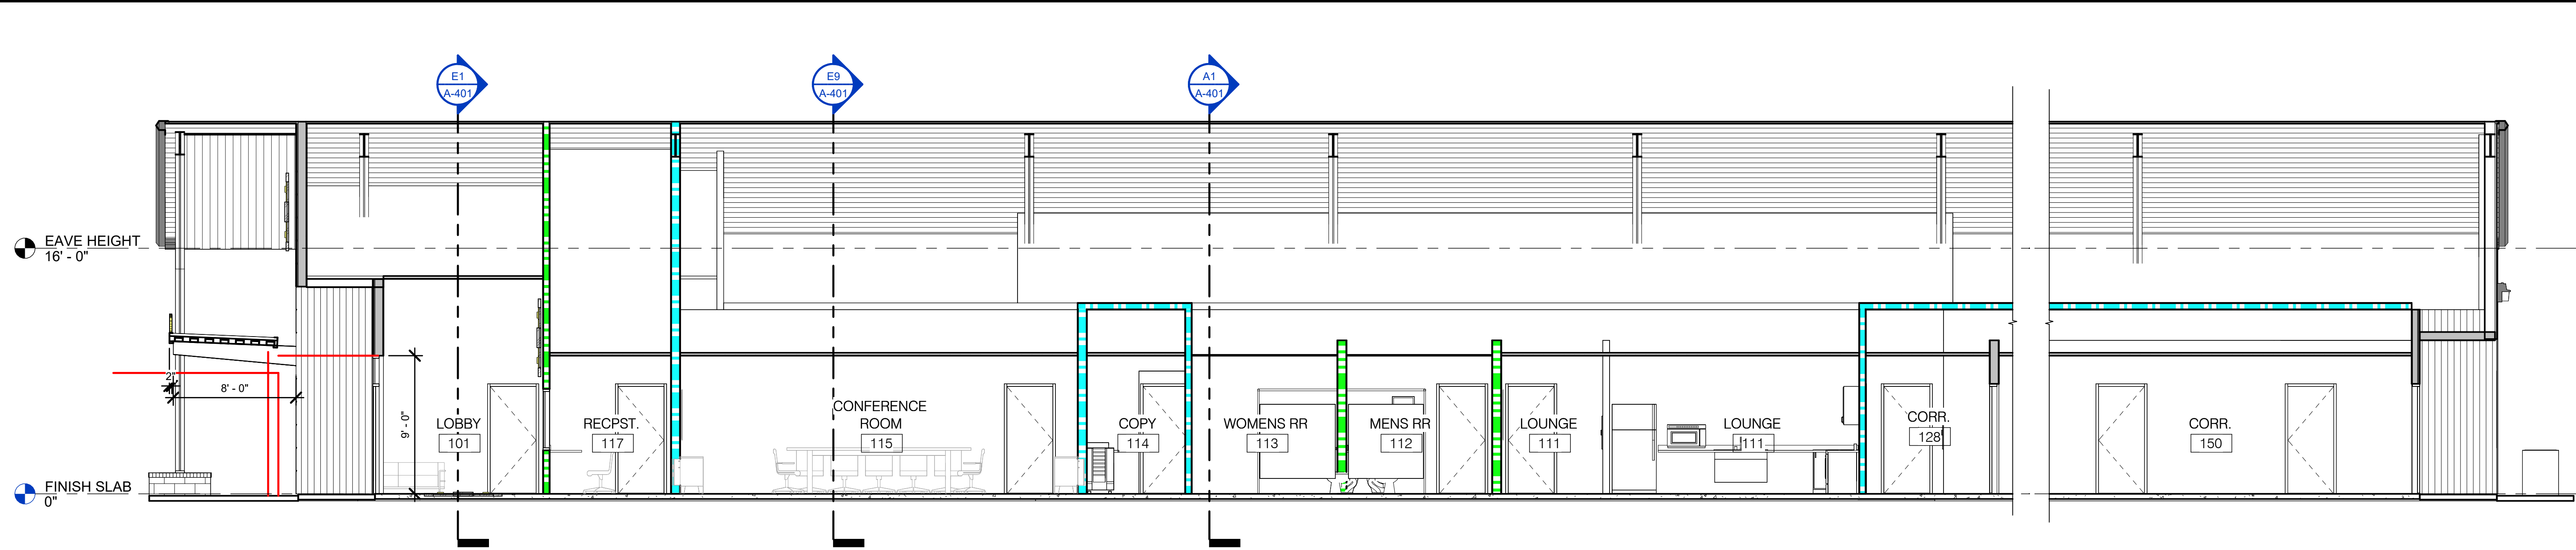


J1 PARTIAL LONGITUDINAL BUILDING SECTION
3/16" = 1'-0"

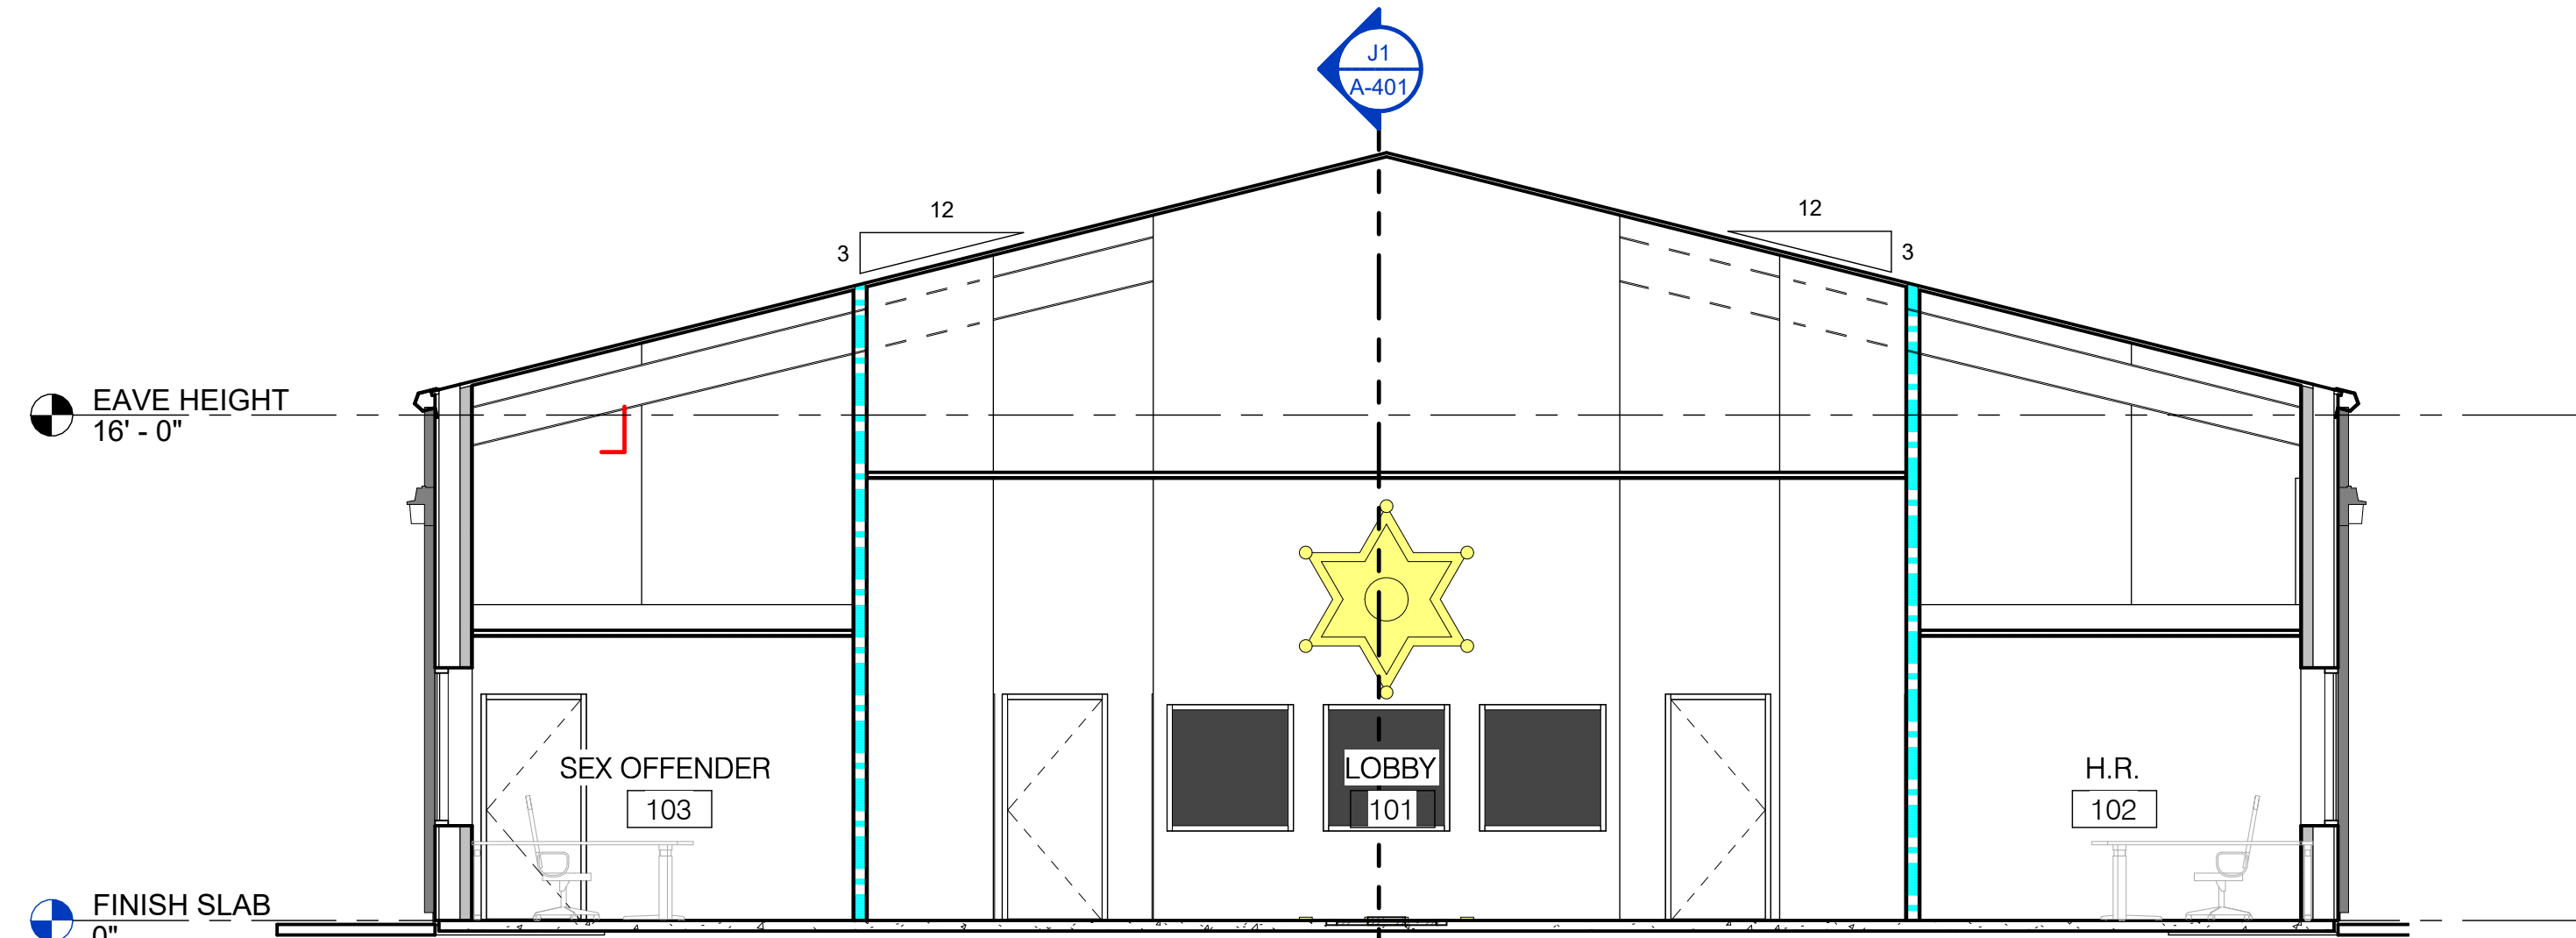


E1 BLDG SEC 1
3/16" = 1'-0"

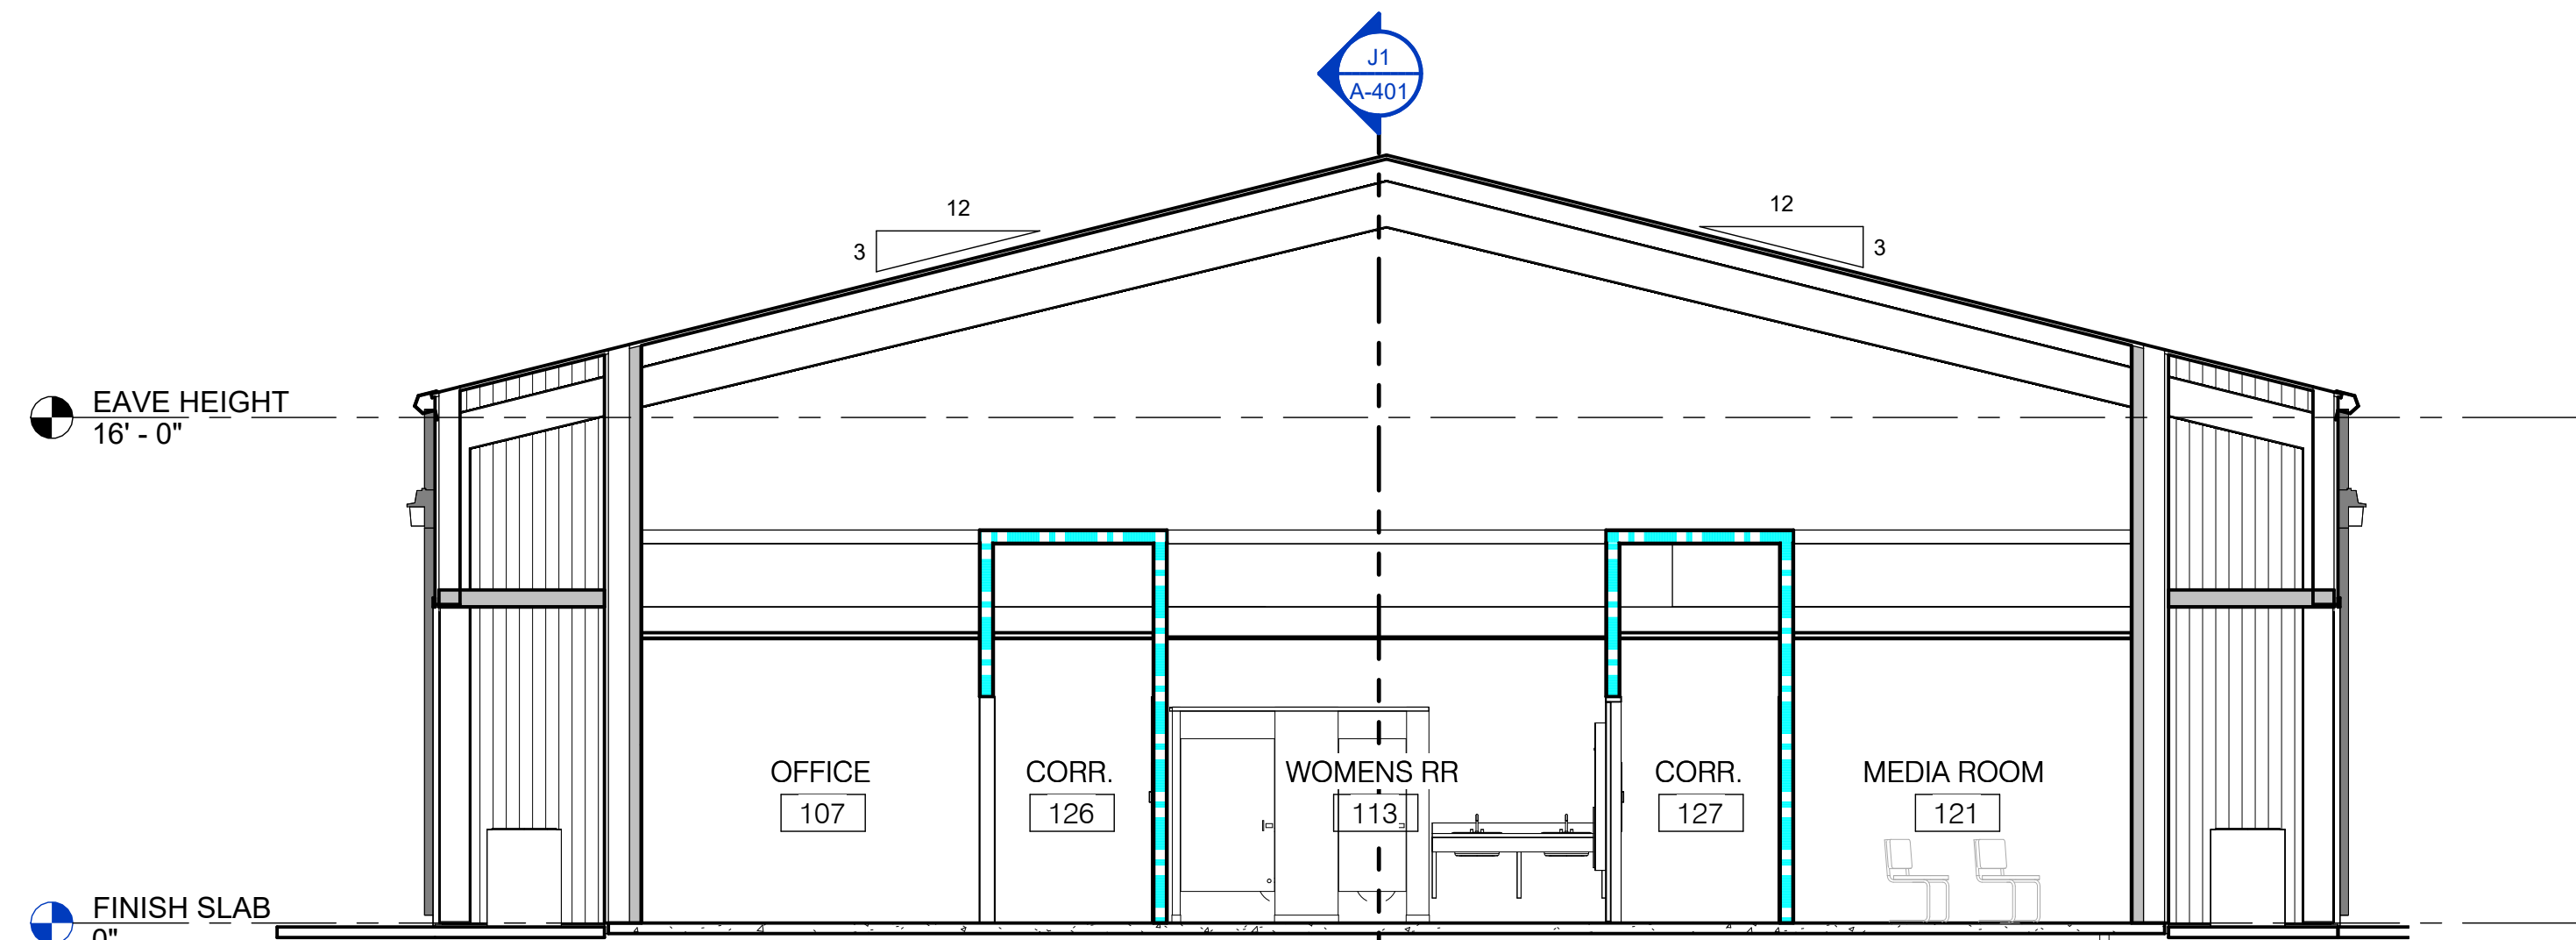

A1 BLDG SEC 3
3/16" = 1'-0"

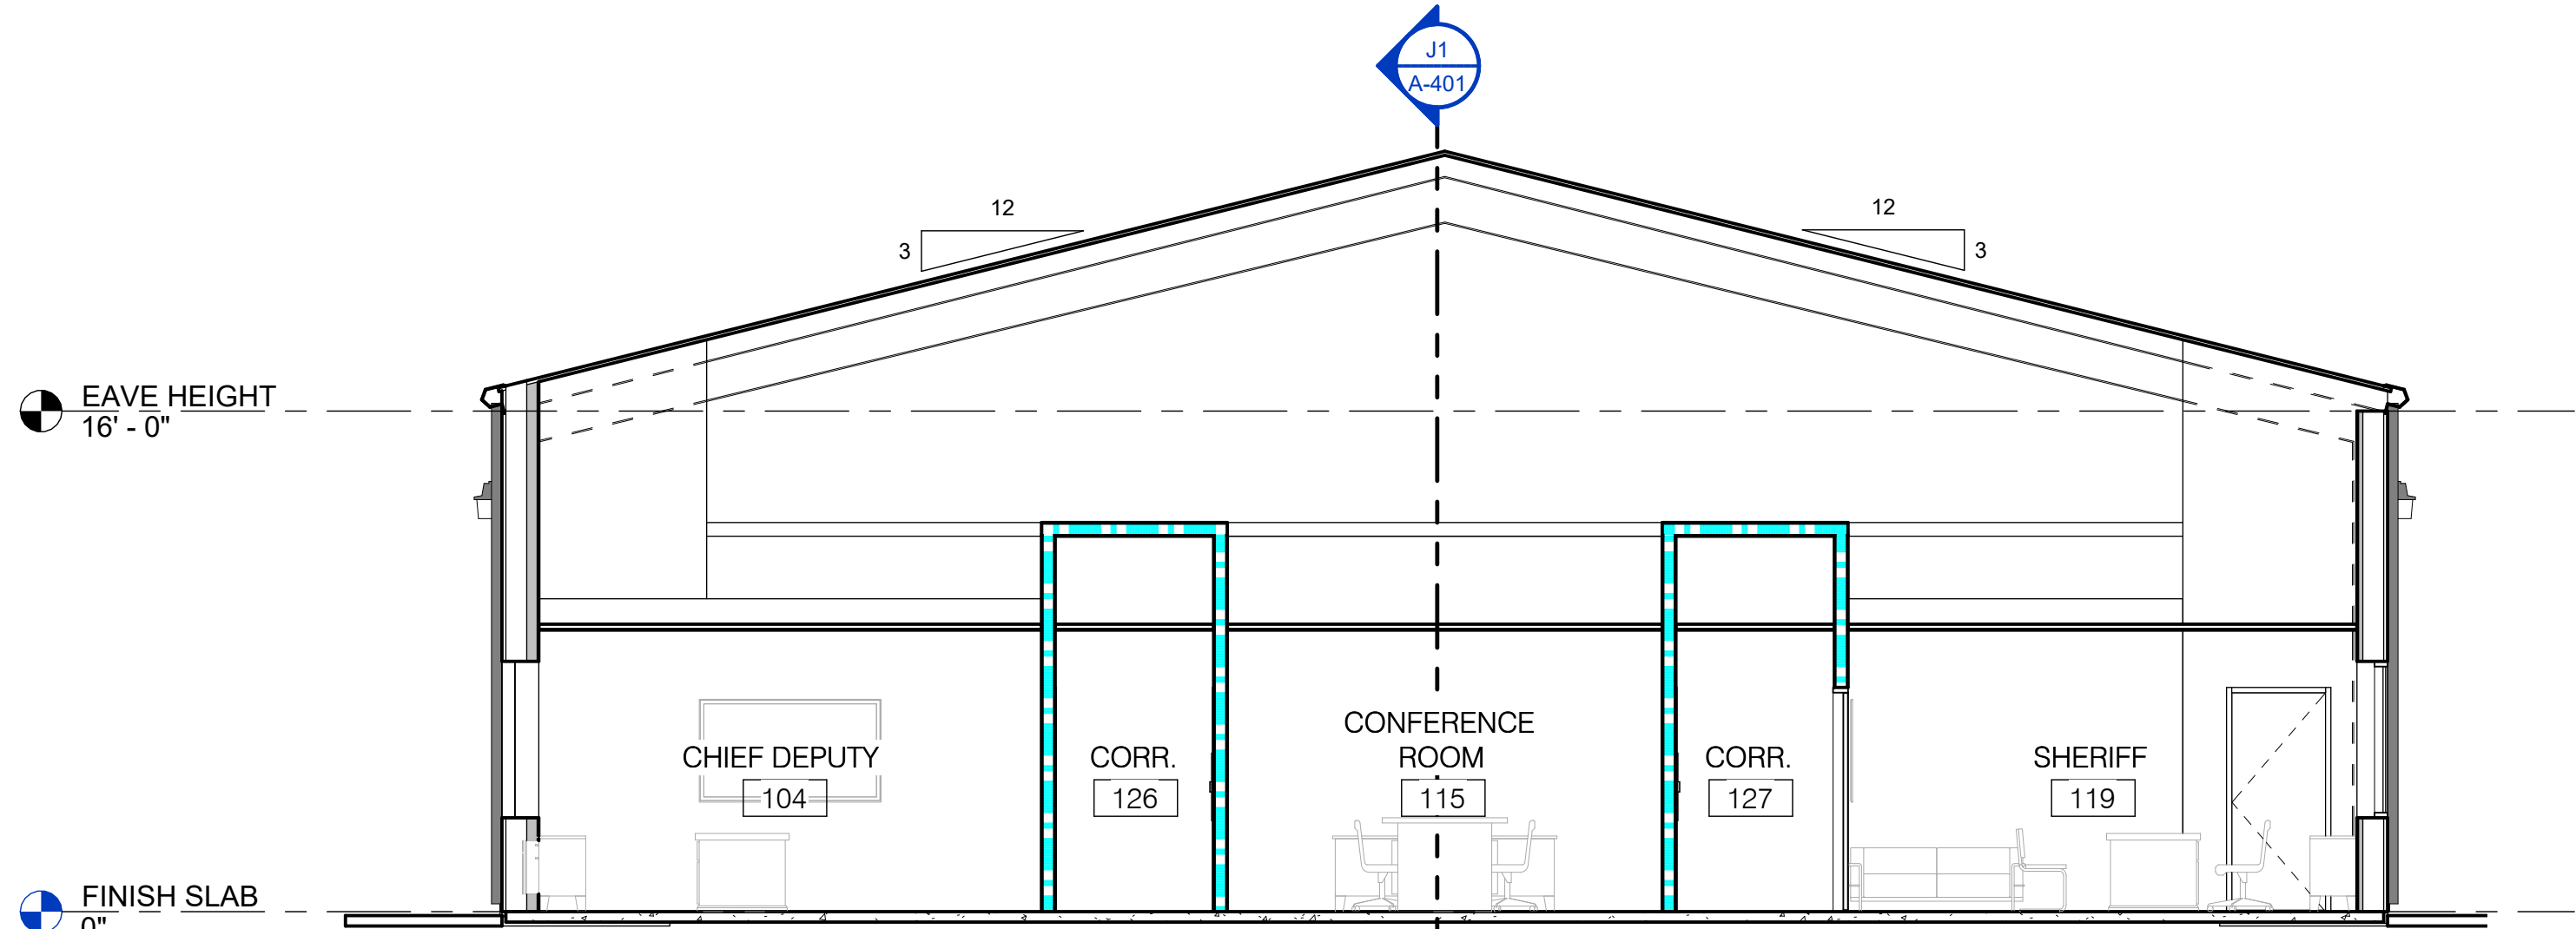

E9 BLDG SEC 2
3/16" = 1'-0"

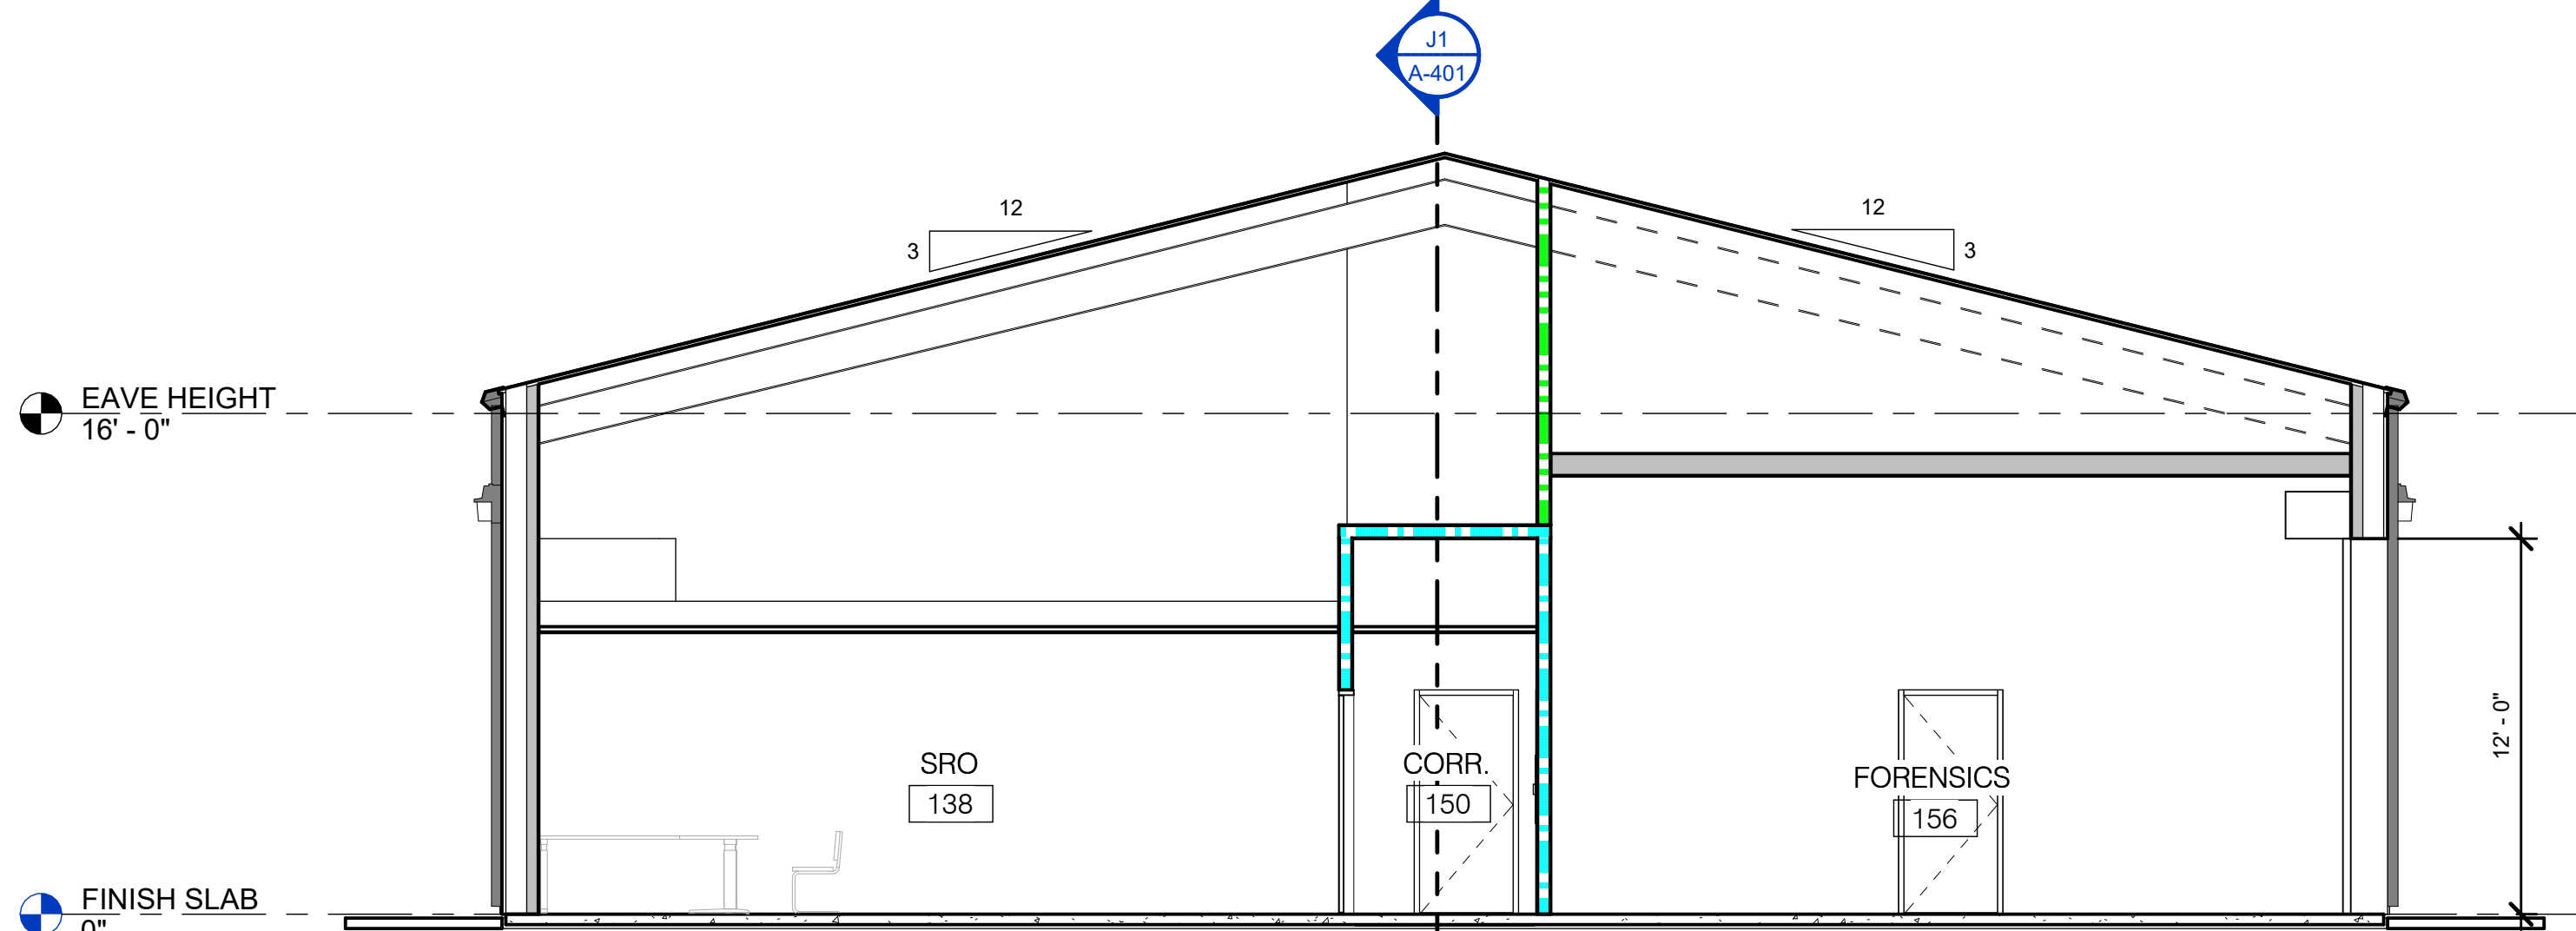

A9 BLDG SEC 4
3/16" = 1'-0"

angelle architects

Limited Liability Company
1011 Berard Street • Breaux Bridge LA • (337) 332-6688 • www.angelle.com

NEW
ST. MARY PARISH SHERIFF'S
COMPLEX

SCHEMATIC
DESIGN REVIEW


REVISIONS

Date	Description
Project No.	23017
Drawn By	DKH
Checked By	GA
Date	JAN. 19, 2024
Scale	3/16" = 1'-0"
Drawing Title	BUILDING SECTIONS

Drawing No.

A-401

1/18/2024 4:57:43 PM

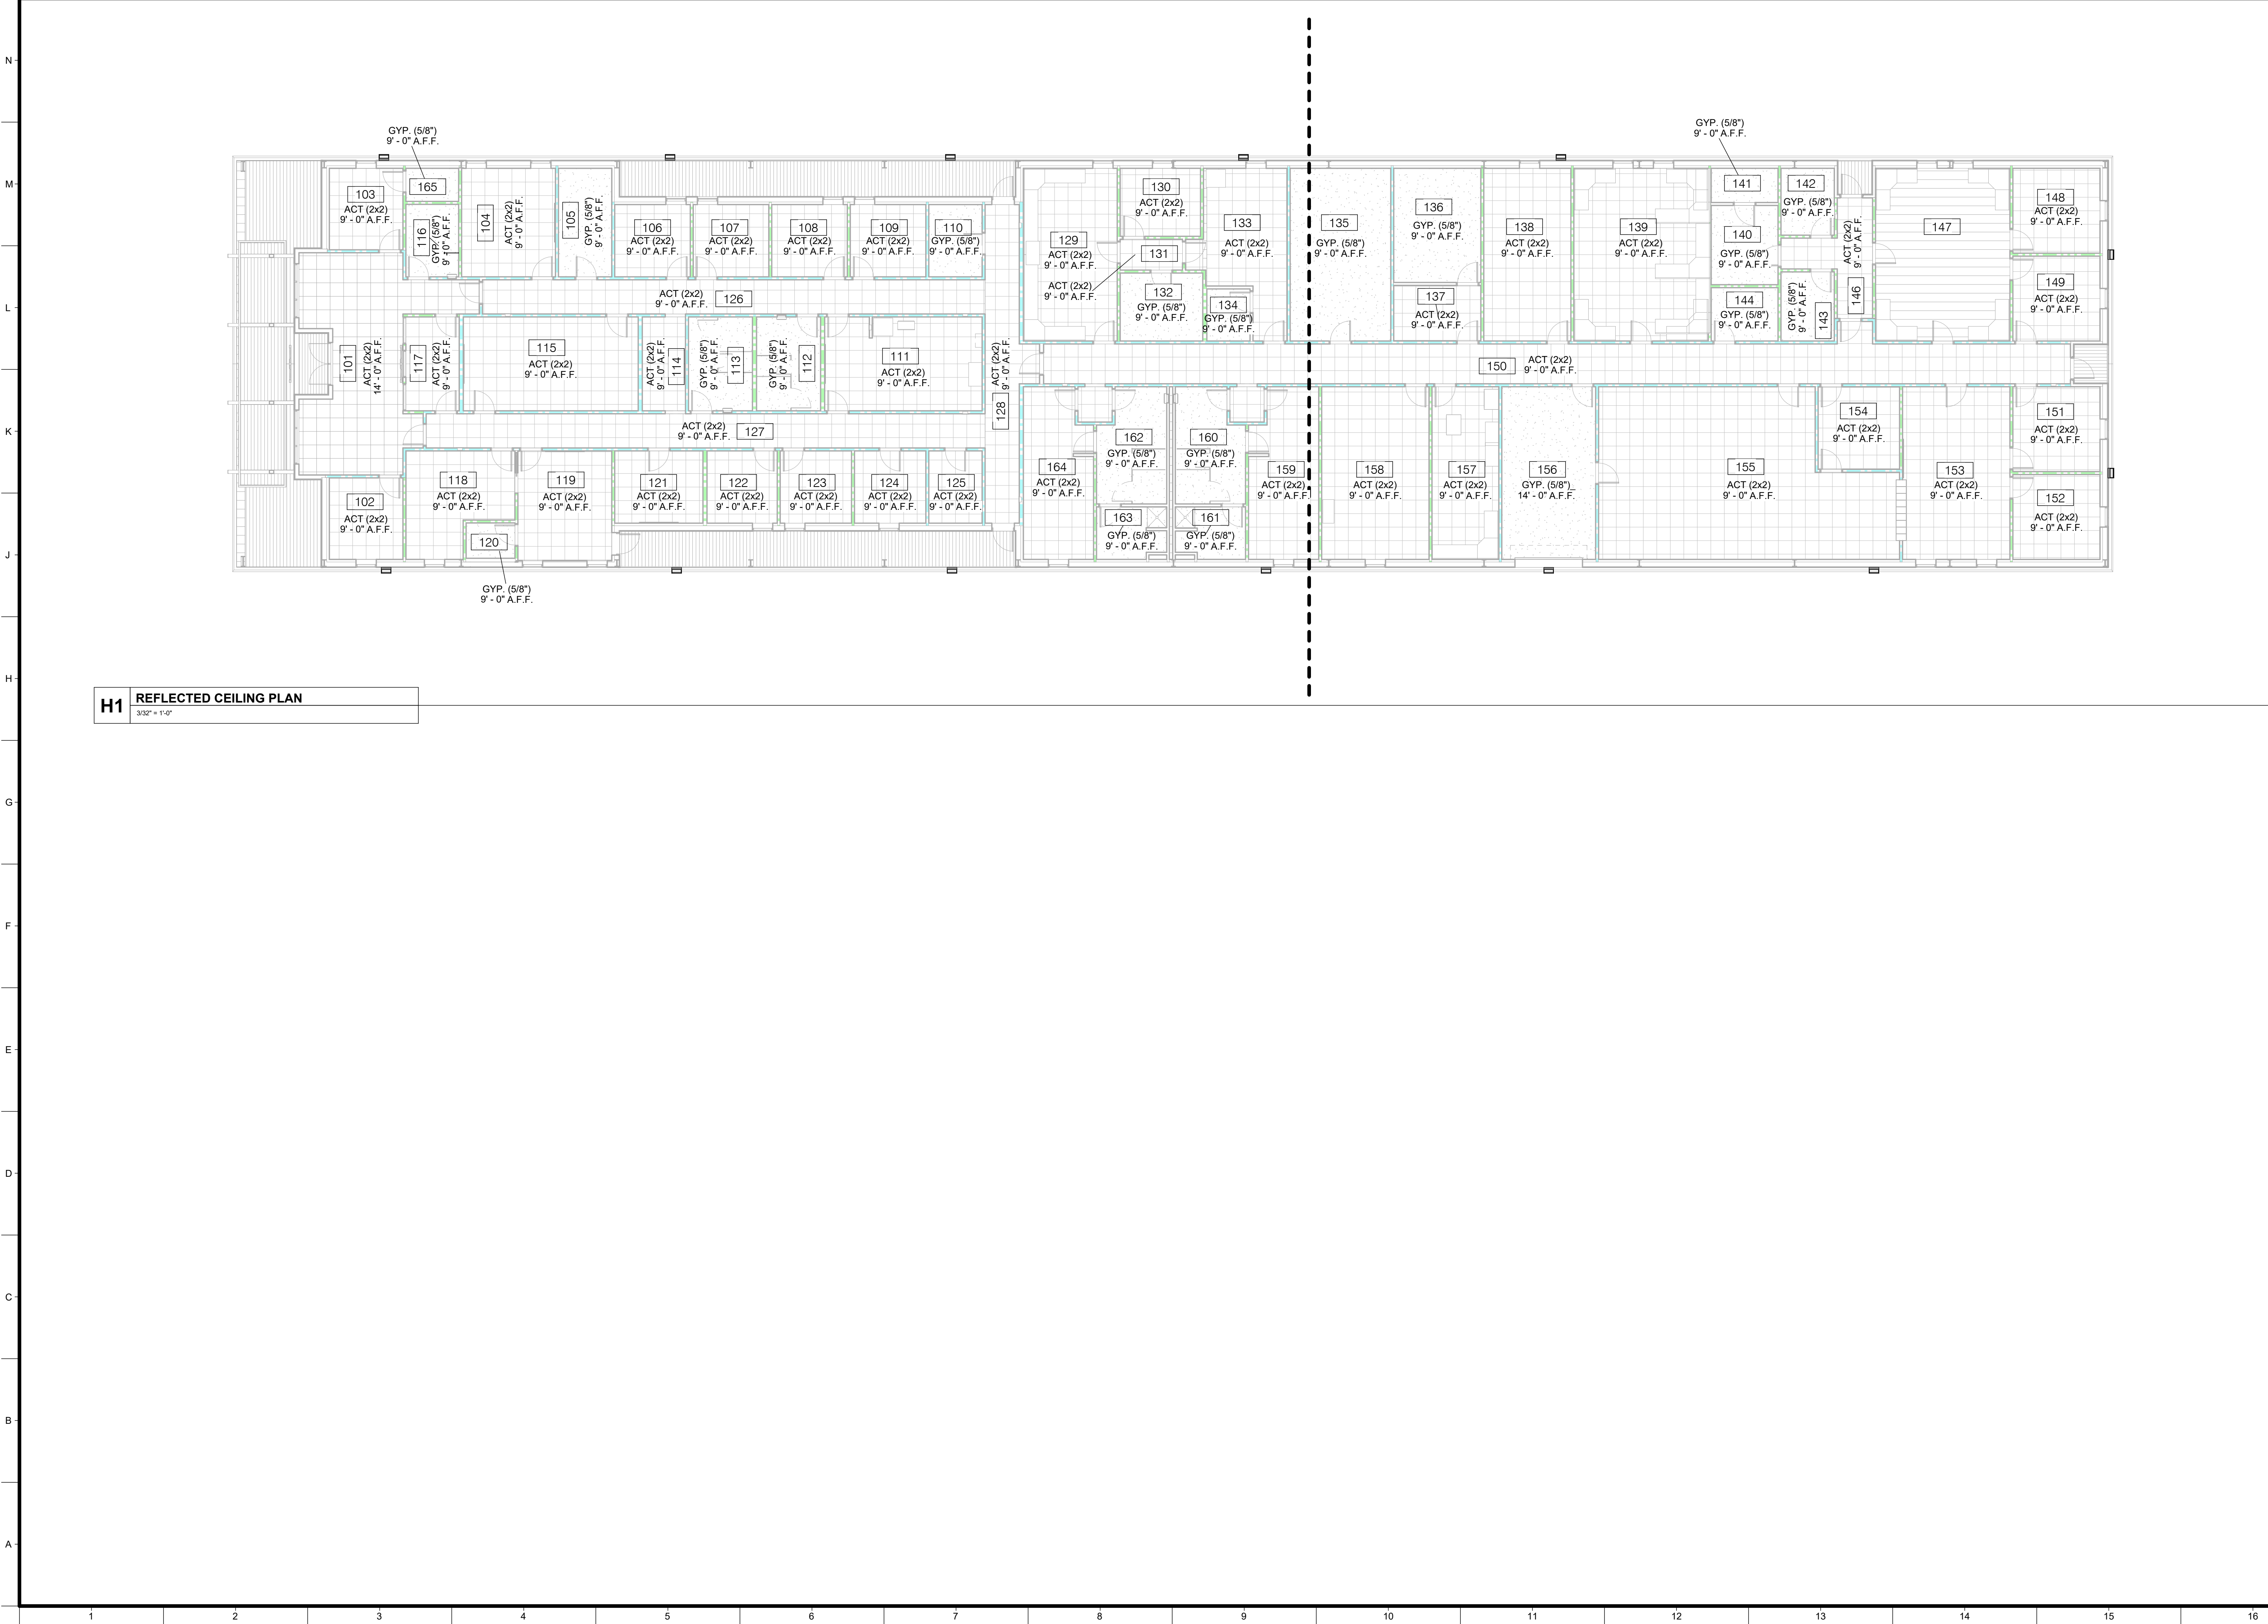

H1 REFLECTED CEILING PLAN
3/32" = 1'-0"



Limited Liability Company
1011 Berard Street • Breaux Bridge LA • (337) 332-6688 • www.angelle.com

NEW

ST. MARY PARISH SHERIFF'S
COMPLEX

...

SCHEMATIC
DESIGN REVIEW

REVISIONS	
Date	Description
Project No. 23017	
Drawn By	DKH
Checked By	GA
Date	JAN. 19, 2024
Scale	3/32" = 1'-0"
Drawing Title REFLECTED CEILING PLAN	
Drawing No. A-901	